



INSTYTUT TECHNIKI BUDOWLANEJ
PL 00-611 WARSZAWA
ul. Filtrowa 1
tel.: (+48 22) 825-04-71
(+48 22) 579-62-94
eta@itb.pl
www.itb.pl



Member of



www.eota.eu

European Technical Assessment

**ETA-21/0767
of 30/08/2021**

General Part

Technical Assessment Body issuing the European Technical Assessment

Instytut Techniki Budowlanej

Trade name of the construction product

EVOLUTION II plus / EVO II plus / EVOLUTION 2+ / EV 2+,
EVOLUTION II plus Standard / EVO II plus Standard / EVOLUTION 2+ (S) / EV 2+ (S),
EVOLUTION II plus Winter / EVO II plus Winter / EVOLUTION 2+ (W) / EV 2+ (W)

Product family to which the construction product belongs

Bonded fasteners for use in concrete

Manufacturer

Selena Spółka Akcyjna
ul. Wyścigowa 56 E
53-012 Wrocław
Poland

Manufacturing plant

Manufacturing Plant no. 3

This European Technical Assessment contains

45 pages including 3 Annexes which form an integral part of this Assessment

This European Technical Assessment is issued in accordance with regulation (EU) No 305/2011, on the basis of

European Assessment Document EAD 330499-01-0601 "Bonded fasteners for use in concrete"

This European Technical Assessment is issued by the Technical Assessment Body in its official language. Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and should be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may be made, with the written consent of the issuing Technical Assessment Body. Any partial reproduction has to be identified as such.

Specific Part

1 Technical description of the product

The EVOLUTION II plus / EVO II plus / EVOLUTION 2+ / EV 2+, EVOLUTION II plus Standard / EVO II plus Standard / EVOLUTION 2+ (S) / EV 2+ (S) and EVOLUTION II plus Winter / EVO II plus Winter / EVOLUTION 2+ (W) / EV 2+ (W) are bonded anchors (injection type) consisting of a injection mortar cartridge using an applicator gun equipped with a special mixing nozzle and steel element.

The steel element consists of:

- threaded anchor rod sizes M8 to M30 made of:
 - galvanized carbon steel,
 - carbon steel with zinc flake coating,
 - stainless steel,
 - high corrosion resistant stainless steel,
 - ultra-high strength steel with zinc flake coating,
 with hexagon nut and washer,
- anchor rod with inner thread sizes M6/Ø10 to M16/Ø24 made of:
 - galvanized carbon steel,
 - stainless steel,
 - high corrosion resistant stainless steel,
- rebar sizes Ø8 to Ø32.

The steel element is placed into a drilled hole previously injected (using an applicator gun) with a mortar with a slow and slight twisting motion. The rod or rebar is anchored by the bond between steel element, mortar and concrete.

The threaded rods are available for all diameters with three type of tip end: a one side 45° chamfer, a two sides 45° chamfer or a flat. The threaded rods are either delivered with the mortar cartridges or commercial standard threaded rods purchased separately. The mortar cartridges are available in different sizes and types.

Description of the products is given in Annex A.

2 Specification of the intended use in accordance with the applicable European Assessment Document (EAD)

The performances given in Section 3 are only valid if the anchors are used in compliance with the specifications and conditions given in Annex B.

The performances given in this European Technical Assessment are based on an assumed working life of the anchor of 50 and/or 100 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

3 Performance of the product and references to the methods used for its assessment

3.1 Performance of the product

3.1.1 Mechanical resistance and stability (BWR 1)

Essential characteristic	Performance
Characteristic resistance to tension load and shear load (static and quasi static loading), displacements	See Annex C1 to C15
Characteristic resistance for seismic performance category C1, displacements	See Annex C16 to C18

3.1.2 Hygiene, health and the environment (BWR 3)

No performance assessed.

3.2 Methods used for the assessment

The assessment of the products has been made in accordance with the EAD 330499-01-0601.

4 Assessment and verification of constancy of performance (AVCP) system applied, with reference to its legal base

According to Decision 96/582/EC of the European Commission the system 1 of assessment and verification of constancy of performance (see Annex V to regulation (EU) No 305/2011) applies.

5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable European Assessment Document (EAD)

Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited at Instytut Techniki Budowlanej.

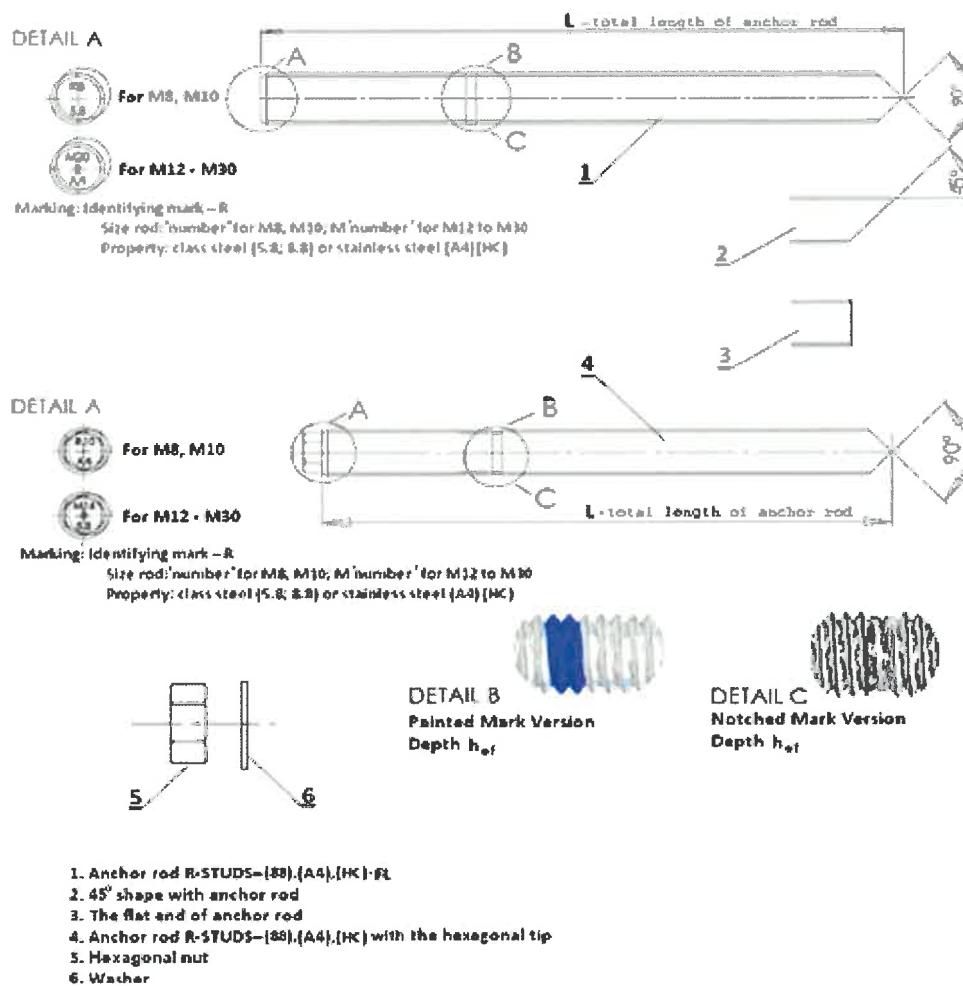
For type testing the results of the tests performed as part of the assessment for the European Technical Assessment shall be used unless there are changes in the production line or plant. In such cases the necessary type testing has to be agreed between Instytut Techniki Budowlanej and the notified body.

Issued in Warsaw 30/08/2021 by Instytut Techniki Budowlanej



Anna Panek, MSc
Deputy Director of ITB

Threaded anchor rods

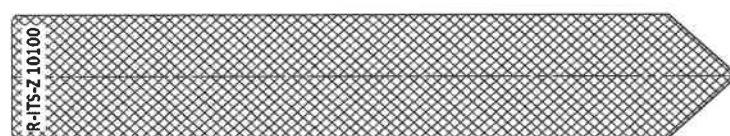
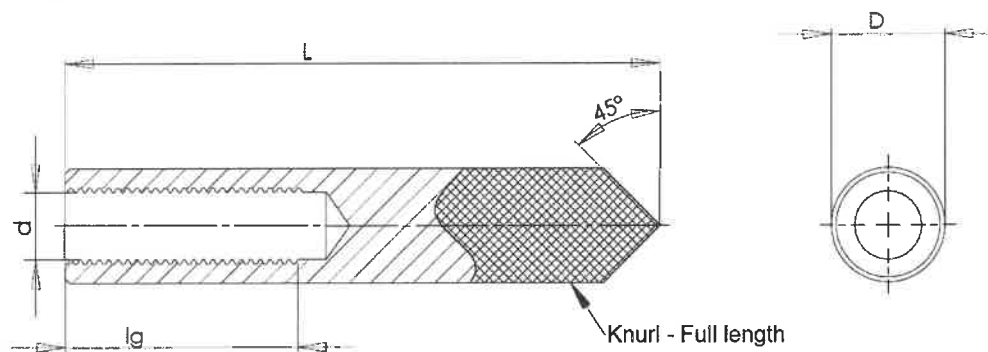


EVOLUTION II plus / EVO II plus / EVOLUTION 2+ / EV 2+,
EVOLUTION II plus Standard / EVO II plus Standard /
EVOLUTION 2+ (S) / EV 2+ (S) and EVOLUTION II plus Winter /
EVO II plus Winter / EVOLUTION 2+ (W) / EV 2+ (W)

Product description
Threaded anchor rods

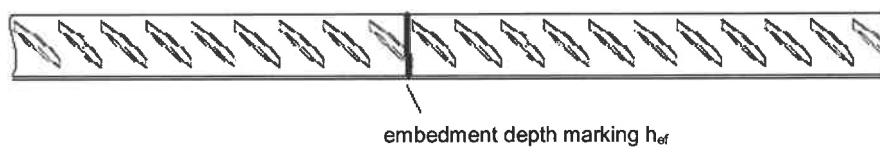
Annex A1
of European
Technical Assessment
ETA-21/0767

Anchor rods with inner thread



Marking: R - Identifying mark
 ITS - product index
 Z - carbon steel or A4 - stainless steel
 XX - thread size
 YYY - length of sleeve

Rebar



EVOLUTION II plus / EVO II plus / EVOLUTION 2+ / EV 2+,
 EVOLUTION II plus Standard / EVO II plus Standard /
 EVOLUTION 2+ (S) / EV 2+ (S) and EVOLUTION II plus Winter /
 EVO II plus Winter / EVOLUTION 2+ (W) / EV 2+ (W)

Product description
 Anchor rods with inner thread and rebar

Annex A2
 of European
 Technical Assessment
 ETA-21/0767

Table A1: Threaded rods

Part	Designation			
	Steel, zinc plated	Stainless steel	High corrosion resistance stainless steel (HCR)	Ultra-high Strength Steel, coated
Threaded rod	Steel, property class 5.8 to 12.9 acc. to EN ISO 898-1 electroplated $\geq 5 \mu\text{m}$ acc. to EN ISO 4042 or hot-dip galvanized $\geq 45 \mu\text{m}$ acc. to EN ISO 10684 or non-electrolytically applied zinc flake coating $\geq 8 \mu\text{m}$ acc. EN ISO 10683	Steel 1.4401, 1.4404, 1.4571 acc. to EN 10088; property class 70 and 80 (A4-70 and A4-80) acc. to EN ISO 3506 Corrosion resistance class CRC III acc. to EN 1993-1-4:2006 +A1:2015	Steel 1.4529, 1.4565, 1.4547 acc. to EN 10088; property class 70 acc. to EN ISO 3506 Corrosion resistance class CRC V acc. to EN 1993-1-4:2006 +A1:2015	Steel, property class 14.8U to 16.8U acc. to USCAR- UHSFG-1416U non-electrolytically zinc flake coating $\geq 8 \mu\text{m}$ acc. EN ISO 10683
Hexagon nut	Steel, property class 5 to 12, acc. to EN ISO 898-2; electroplated $\geq 5 \mu\text{m}$ acc. to EN ISO 4042 or hot-dip galvanized $\geq 45 \mu\text{m}$ acc. to EN ISO 10684 or non-electrolytically applied zinc flake coating $\geq 8 \mu\text{m}$ acc. EN ISO 10683	Steel 1.4401, 1.4404, 1.4571 acc. to EN 10088; property class 70 and 80 (A4-70 and A4-80) acc. to EN ISO 3506 Corrosion resistance class CRC III acc. to EN 1993-1-4:2006 +A1:2015	Steel 1.4529, 1.4565, 1.4547 acc. to EN 10088; property class 70 acc. to EN ISO 3506 Corrosion resistance class CRC V acc. to EN 1993-1-4:2006 +A1:2015	Steel, property class 12 to 16 acc. to USCAR- UHSFG-1416U non-electrolytically applied zinc flake coating $\geq 8 \mu\text{m}$ acc. EN ISO 10683
Washer	Steel acc. to EN ISO 7089; electroplated $\geq 5 \mu\text{m}$ acc. to EN ISO 4042 or hot-dip galvanized $\geq 45 \mu\text{m}$ acc. to EN ISO 10684 or non-electrolytically applied zinc flake coating $\geq 8 \mu\text{m}$ acc. EN ISO 10683	Steel 1.4401, 1.4404, 1.4571 acc. to EN 10088 Corrosion resistance class CRC III acc. to EN 1993-1-4:2006 +A1:2015	Steel 1.4529, 1.4565, 1.4547 acc. to EN 10088 Corrosion resistance class CRC V acc. to EN 1993-1-4:2006 +A1:2015	Steel acc. to EN ISO 7089; non-electrolytically applied zinc flake coating $\geq 8 \mu\text{m}$ acc. EN ISO 10683

Commercial threaded rods (in the case of rods made of galvanized steel – standard rods with property class ≤ 8.8 only), with:

- material and mechanical properties according to Table A1,
- confirmation of material and mechanical properties by inspection certificate 3.1 according to EN- 10204:2004; the documents shall be stored,
- marking of the threaded rod with the embedment depth.

Note: Commercial threaded rods made of galvanized steel with property class above 8.8 are not permitted in some Member States.

**EVOLUTION II plus / EVO II plus / EVOLUTION 2+ / EV 2+,
EVOLUTION II plus Standard / EVO II plus Standard /
EVOLUTION 2+ (S) / EV 2+ (S) and EVOLUTION II plus Winter /
EVO II plus Winter / EVOLUTION 2+ (W) / EV 2+ (W)**

Product description
Materials

Annex A3
of European
Technical Assessment
ETA-21/0767

Table A2: Rods with inner threaded

Part	Material		
	Steel, zinc plated	Stainless steel	High corrosion resistance stainless steel (HCR)
Rod with inner threaded	Steel, property class 5.8 to 8.89 acc. to EN ISO 898-1 electroplated $\geq 5 \mu\text{m}$ acc. to EN ISO 4042 or hot-dip galvanized $\geq 45 \mu\text{m}$ acc. to EN ISO 10684	Steel 1.4401, 1.4404, 1.4571 acc. to EN 10088; property class 70 and 80 (A4-70 and A4-80) acc. to EN ISO 3506 acc. to EN ISO 3506 Corrosion resistance class CRC III acc. to EN 1993-1-4:2006 +A1:2015	Steel 1.4529, 1.4565, 1.4547 acc. to EN 10088; property class 70 acc. to EN ISO 3506 Corrosion resistance class CRC V acc. to EN 1993-1-4:2006 +A1:2015

Table A3: Reinforcing bars according to EN 1992-1-1, Annex C

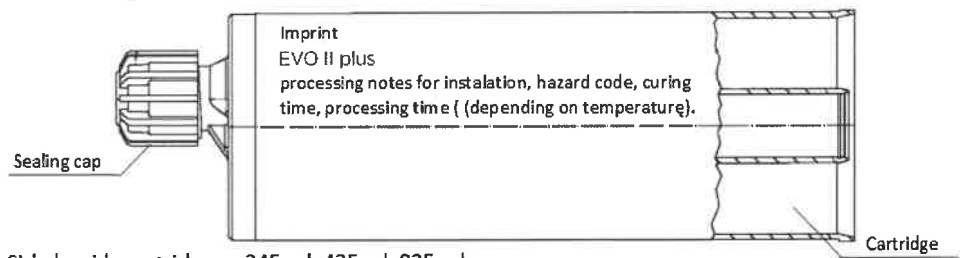
Product form		Bars and de-coiled rods	
Class		B	C
Characteristic yield strength f_{yk} or $f_{0,2k}$ [N/mm ²]		400 to 600	
Minimum value of $k = (f_t / f_y)_k$		$\geq 1,08$	$\geq 1,15$ $< 1,35$
Characteristic strain at maximum force, ϵ_{uk} [%]		$\geq 5,0$	$\geq 7,5$
Bendability		Bend / Rebend test	
Maximum deviation from nominal mass (individual bar) [%]	Nominal bar size [mm]		
	≤ 8	$\pm 6,0$	
	> 8	$\pm 4,5$	
Bond: minimum relative rib area, $f_{R,min}$	Nominal bar size [mm]		
	8 to 12	0,040	
	> 12	0,056	

Rib height h: The maximum rib height h_{rib} shall be: $h_{rib} \leq 0,07 \cdot \varnothing$

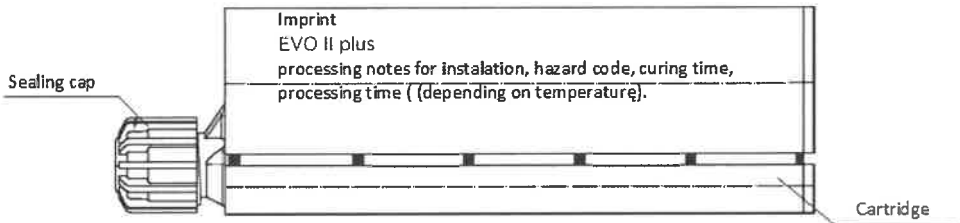
Table A4: Injection mortars

Product	Composition
EVOLUTION II plus / EVO II plus / EVOLUTION 2+ / EV 2+ EVOLUTION II plus Standard / EVO II plus Standard / EVOLUTION 2+ (S) / EV 2+ (S) EVOLUTION II plus Winter / EVO II plus Winter / EVOLUTION 2+ (W) / EV 2+ (W) (two component injection mortars)	Additive: quartz Bonding agent: vinyl ester mortar styrene free Hardener: dibenzoyl peroxide
EVOLUTION II plus / EVO II plus / EVOLUTION 2+ / EV 2+, EVOLUTION II plus Standard / EVO II plus Standard / EVOLUTION 2+ (S) / EV 2+ (S) and EVOLUTION II plus Winter / EVO II plus Winter / EVOLUTION 2+ (W) / EV 2+ (W)	
Product description Materials	Annex A4 of European Technical Assessment ETA-21/0767

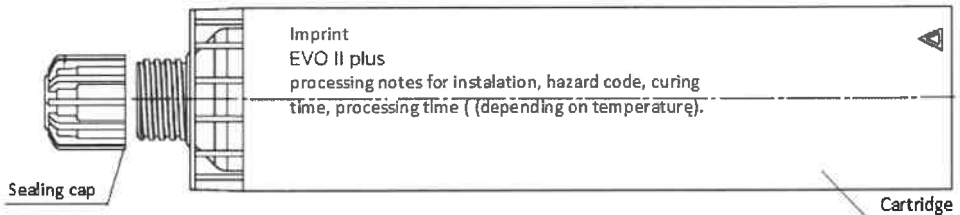
Coaxial cartridges – 150 ml, 280 ml, 300 ml, 310 ml, 330 ml, 380 ml, 400 ml, 410 ml, 420 ml




Side by side cartridges – 345 ml, 425 ml, 825 ml



Cartridges for two part foil capsules within a single components –
150 ml, 280 ml, 300 ml, 310 ml, 330 ml, 380 ml, 400 ml, 550 ml, 600 ml



Mixer for Cartridge



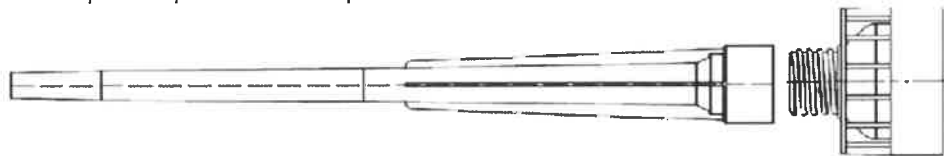
Foil capsule – 150 ml, 175 ml, 280 ml, 300 ml, 310 ml, 380 ml, 550 ml, 600 ml



Mixer for foil capsule



Mixer standard plus adapter + for foil capsule



**EVOLUTION II plus / EVO II plus / EVOLUTION 2+ / EV 2+,
EVOLUTION II plus Standard / EVO II plus Standard /
EVOLUTION 2+ (S) / EV 2+ (S) and EVOLUTION II plus Winter /
EVO II plus Winter / EVOLUTION 2+ (W) / EV 2+ (W)**

Product description
Cartridge types and sizes

Annex A5
of European
Technical Assessment
ETA-21/0767

Specification of intended use

Anchorage subject to:

Static and quasi-static loads: threaded rod size M8 to M30, rod with inner thread sizes M6/Ø10 to M16/Ø24 and rebar Ø8 to Ø32.

Seismic performance category C1: threaded rod size M8 to M30 and rebar Ø8 to Ø32

Base material:

- Reinforced or unreinforced normal weight concrete of strength class C20/25 to C50/60 according to EN 206.
- Cracked and uncracked concrete.

Temperature ranges:

Installation temperature (temperature of substrate):

- 5°C to +40°C in case of EVOLUTION II plus / EVO II plus / EVOLUTION 2+ / EV 2+ (standard version).
- +5°C to +40°C in case of EVOLUTION II plus Standard / EVO II plus Standard / EVOLUTION 2+ (S) / EV 2+ (S) (version for summer season).
- 20°C to +40°C in case of EVOLUTION II plus Winter / EVO II plus Winter / EVOLUTION 2+ (W) / EV 2+ (W) (version for winter season).

In-service temperature:

The anchors may be used in the following temperature range:

- 40°C to +40°C (max. short term temperature +40°C and max. long term temperature +24°C).
- 40°C to +80°C (max. short term temperature +80°C and max. long term temperature +50°C).
- 40°C to +120°C (max. short term temperature +120°C and max. long term temperature +80°C).

Use conditions (environmental conditions):

- Structures subject to dry internal conditions: all materials.
- For all other conditions according to EN 1993-1-4:2006+A1:2015 corresponding to corrosion resistance class (CRC): elements made of stainless steel or high corrosion resistance stainless steel (HCR).

Installation:

- Dry or wet concrete (use category I1).
- Flooded holes (use category I2).
- Installation direction D3 (downward and horizontal and upwards installation).
- The anchors are suitable for hammer drilled holes or by special method with cleaning during drill a hole using hollow drill bit with vacuum cleaner.

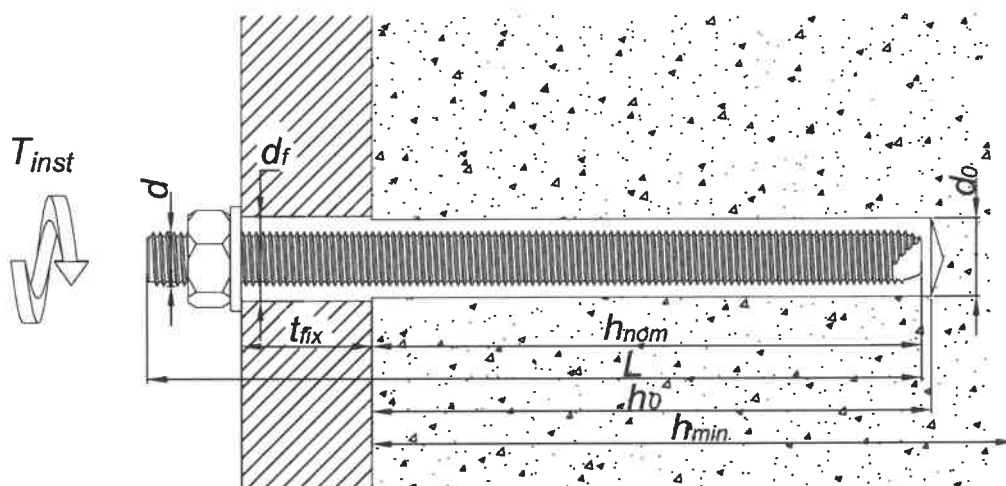
Design methods:

- Anchorage under static or quasi-static loads are designed in accordance to EN 1992-4:2018 and EOTA Technical Report TR 055.
- Anchors are designed under the responsibility of the engineer experienced in anchorages and concrete work.
- Verifiable calculation notes and drawings are prepared taking account of the loads to be anchored. The position of the anchor is indicated on the design drawings (e.g. position of the anchor relative to reinforcement or to supports, etc.).
- Anchorage under seismic actions (cracked concrete) have to be designed in accordance to EN 1992-4:2018.

**EVOLUTION II plus / EVO II plus / EVOLUTION 2+ / EV 2+,
EVOLUTION II plus Standard / EVO II plus Standard /
EVOLUTION 2+ (S) / EV 2+ (S) and EVOLUTION II plus Winter /
EVO II plus Winter / EVOLUTION 2+ (W) / EV 2+ (W)**

**Intended use
Specifications**

Annex B1
of European
Technical Assessment
ETA-21/0767

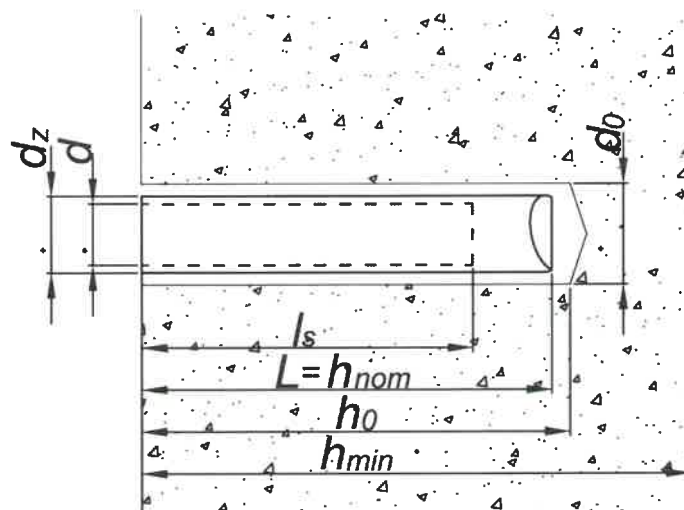
**Table B1: Installation parameters – threaded anchor rod**

Size		M8	M10	M12	M16	M20	M24	M30
Diameter of anchor rod	d [mm]	8	10	12	16	20	24	30
Nominal drilling diameter	d ₀ [mm]	10	12	14	18	24	28	35
Maximum diameter hole in the fixture	d _f [mm]	9	12	14	18	22	26	33
Effective embedment depth	h _{ef,min} [mm]	60	60	60	60	80	96	120
	h _{ef,max} [mm]	160	200	240	320	400	480	600
Depth of the drilling hole	h ₀ [mm]	h _{ef} + 5 mm						
Minimum thickness of the concrete slab	h _{min} [mm]	h _{ef} + 30 mm; ≥ 100 mm				h _{ef} + 2d ₀		
Maximum installation torque	T _{inst,max} [N·m]	10	20	40	80	120	160	200
Minimum spacing	s _{min} [mm]	40	40	40	40	40	50	60
Minimum edge distance	c _{min} [mm]	40	40	40	40	40	50	60

**EVOLUTION II plus / EVO II plus / EVOLUTION 2+ / EV 2+,
EVOLUTION II plus Standard / EVO II plus Standard /
EVOLUTION 2+ (S) / EV 2+ (S) and EVOLUTION II plus Winter /
EVO II plus Winter / EVOLUTION 2+ (W) / EV 2+ (W)**

Intended use
Installation parameters – threaded anchor rod

Annex B2
of European
Technical Assessment
ETA-21/0767

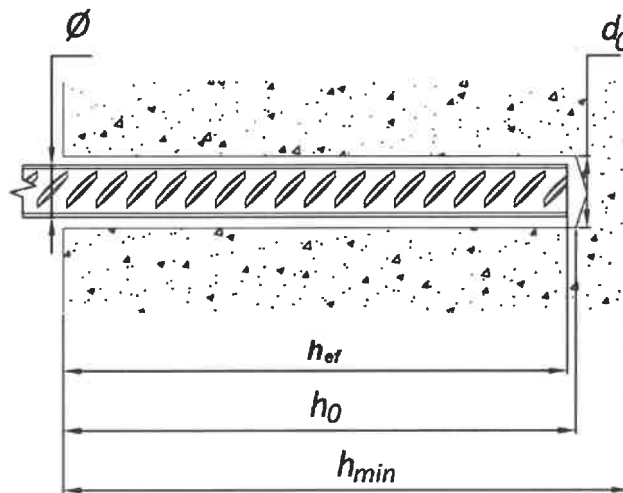
**Table B2: Installation parameters – anchor rod with inner thread**

Size		M6/ Ø10 /75	M8/ Ø12/ 75	M8/ Ø12/ 90	M10/Ø 16/ 75	M10/Ø 16/ 100	M12/Ø 16/ 100	M16/Ø 24/ 125
Nominal drilling diameter	d_0 [mm]	12	14	14	20	20	20	28
Maximum diameter hole in the fixture	d_f [mm]	7	9	9	12	12	14	18
Effective embedment depth	$h_{ef} = h_{nom}$ [mm]	75	75	90	75	100	100	125
Thread length, min	l_s [mm]	24	25	25	30	30	35	50
Depth of the drilling hole	h_0 [mm]	$h_{ef} + 5$ mm						
Minimum thickness of the concrete slab	h_{min} [mm]	$h_{ef} + 30$ mm; ≥ 100 mm				$h_{ef} + 2d_0$		
Maximum installation torque	$T_{inst,max}$ [N·m]	3	5	5	10	10	20	40
Minimum spacing	s_{min} [mm]	40	40	50	40	50	50	70
Minimum edge distance	c_{min} [mm]	40	40	50	40	50	50	70

**EVOLUTION II plus / EVO II plus / EVOLUTION 2+ / EV 2+,
EVOLUTION II plus Standard / EVO II plus Standard /
EVOLUTION 2+ (S) / EV 2+ (S) and EVOLUTION II plus Winter /
EVO II plus Winter / EVOLUTION 2+ (W) / EV 2+ (W)**

Intended use
Installation parameters – anchor rod with inner thread

Annex B3
of European
Technical Assessment
ETA-21/0767

**Table B3: Installation parameters – rebar**

Size		Ø8	Ø10	Ø12	Ø14	Ø16	Ø20	Ø25	Ø32
Nominal drilling diameter	d_0 [mm]	12	14	18	18	22	26	32	40
Effective embedment depth	$h_{ef,min}$ [mm]	60	60	60	60	64	80	100	128
	$h_{ef,max}$ [mm]	160	200	240	240	320	400	500	640
Depth of the drilling hole	h_0 [mm]	$h_{ef} + 5$ mm							
Minimum thickness of the concrete slab	h_{min} [mm]	$h_{ef} + 30$ mm; ≥ 100 mm				$h_{ef} + 2d_0$			
Minimum spacing	s_{min} [mm]	40	40	40	40	40	40	50	70
Minimum edge distance	c_{min} [mm]	40	40	40	40	40	40	50	70

**EVOLUTION II plus / EVO II plus / EVOLUTION 2+ / EV 2+,
EVOLUTION II plus Standard / EVO II plus Standard /
EVOLUTION 2+ (S) / EV 2+ (S) and EVOLUTION II plus Winter /
EVO II plus Winter / EVOLUTION 2+ (W) / EV 2+ (W)**

Intended use
Installation parameters – rebar

Annex B4
of European
Technical Assessment
ETA-21/0767

Table B4: Maximum processing time and minimum curing time

EVOLUTION II plus / EVO II plus / EVOLUTION 2+ / EV 2+ (standard version)			
Temperature of mortar [°C]	Temperature of substrate [°C]	Maximum processing (open) time [min]	Minimum curing time ¹⁾ [min]
+5	-5	40	1440
+5	0	30	180
+5	+5	15	90
+10	+10	8	60
+15	+15	5	60
+20	+20	2,5	45
+25	+25	2	45
+25	+30	2	45
+25	+35	1,5	30
+25	+40	1,5	30

Table B5: Maximum processing time and minimum curing time

EVOLUTION II plus Standard / EVO II plus Standard / EVOLUTION 2+ (S) / EV 2+ (S) (version for summer season)			
Temperature of mortar [°C]	Temperature of substrate [°C]	Maximum processing time [min.]	Minimum curing time ¹⁾ [min.]
+5	+5	40	720
+10	+10	20	480
+15	+15	15	360
+20	+20	10	240
+25	+25	9,5	180
+25	+30	7	120
+25	+35	6,5	120
+25	+40	6,5	90

Table B6: Maximum processing time and minimum curing time

EVOLUTION II plus Winter / EVO II plus Winter / EVOLUTION 2+ (W) / EV 2+ (W) (version for winter season)			
Temperature of mortar [°C]	Temperature of substrate [°C]	Maximum processing time [min.]	Minimum curing time ¹⁾ [min.]
+5	-20	100	1440
+5	-15	60	960
+5	-10	40	480
+5	-5	20	240
+5	0	14	120
+5	+5	9	60
+10	+10	5,5	45
+15	+15	3	30
+20	+20	2	15
+25	+25	1,5	10
+25	+30	1,5	10
+25	+35	1	5
+25	+40	1	5

¹⁾ The minimum time from the end of the mixing to the time when the anchor may be torque or loaded (whichever is longer). Minimum mortar temperature for installation +5°C; maximum mortar temperature for installation +25°C. For wet condition and flooded holes the curing time must be doubled.

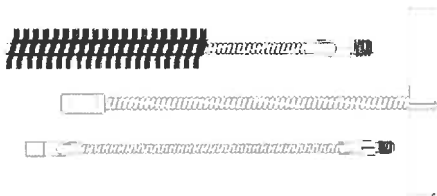
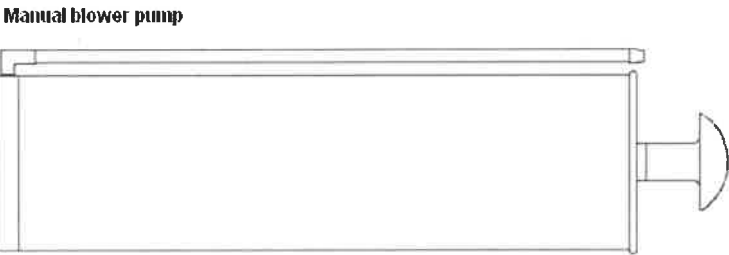
**EVOLUTION II plus / EVO II plus / EVOLUTION 2+ / EV 2+,
EVOLUTION II plus Standard / EVO II plus Standard /
EVOLUTION 2+ (S) / EV 2+ (S) and EVOLUTION II plus Winter /
EVO II plus Winter / EVOLUTION 2+ (W) / EV 2+ (W)**

Intended use
Maximum processing time and minimum curing time

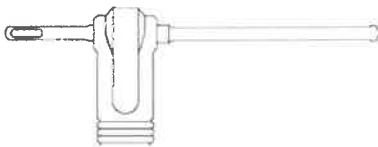
Annex B5
of European
Technical Assessment
ETA-21/0767



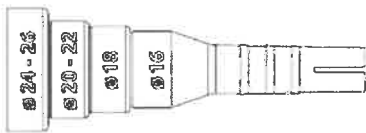
*Variable length from 300 mm up 1000 mm




Brush with extension



Hollow drill bit with vacuum cleaner



Piston plugs



Temporary centring wedge

EVOLUTION II plus / EVO II plus / EVOLUTION 2+ / EV 2+,
EVOLUTION II plus Standard / EVO II plus Standard /
EVOLUTION 2+ (S) / EV 2+ (S) and EVOLUTION II plus Winter /
EVO II plus Winter / EVOLUTION 2+ (W) / EV 2+ (W)

Intended use
Tools (1)

Annex B6
of European
Technical Assessment
ETA-21/0767








Dispensers	Cartridge or foil capsule size
 <p>Manual gun for coaxial cartridges</p>	380, 400, 410 and 420 ml
 <p>Manual gun for side by side cartridges</p>	345 ml
 <p>Manual gun for foil capsule in cartridge and coaxial cartridges</p>	150, 175, 280, 300 and 310 ml
 <p>Manual gun for foil capsules</p>	300 to 600 ml
 <p>Cordless dispenser gun for coaxial cartridges</p>	380, 400, 410 and 420 ml
 <p>Cordless dispenser gun for foil capsules</p>	300 to 600 ml
 <p>Pneumatic gun for coaxial cartridges</p>	380, 400, 410 and 420 ml
<p>EVOLUTION II plus / EVO II plus / EVOLUTION 2+ / EV 2+, EVOLUTION II plus Standard / EVO II plus Standard / EVOLUTION 2+ (S) / EV 2+ (S) and EVOLUTION II plus Winter / EVO II plus Winter / EVOLUTION 2+ (W) / EV 2+ (W)</p>	<p>Annex B7 of European Technical Assessment ETA-21/0767</p>
<p>Intended use Tools (2)</p>	

Table B7: Brush diameter for threaded rod

Threaded rod diameter			M8	M10	M12	M16	M20	M24	M30
d _b	Brush diameter	[mm]	12	14	16	20	26	30	37

Table B8: Standard brush diameter for rod with inner thread

Threaded rod diameter			M6/Ø10	M8/Ø12	M10/Ø16	M12/ Ø16	M16/Ø24
d _b	Brush diameter	[mm]	16	16	22	22	30

Table B9: Brush diameter for rebar

Rebar diameter			Ø8	Ø10	Ø12	Ø14	Ø16	Ø20	Ø25	Ø32
d _b	Brush diameter	[mm]	14	16	20	20	24	28	37	42


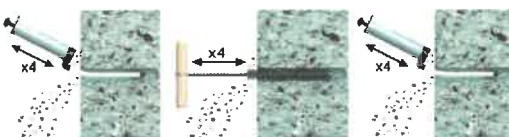
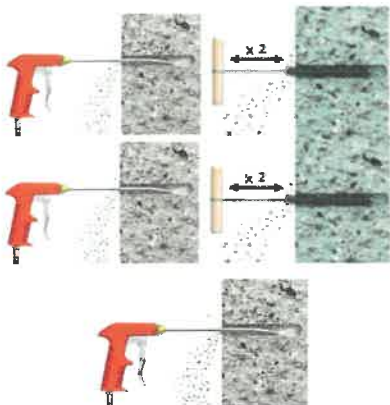





Table B10: Piston plug size

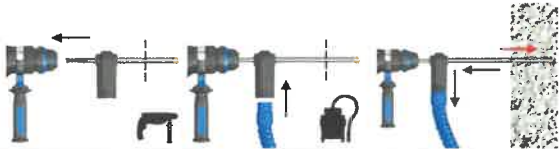





Hole diameter [mm]	16	18	20	22	24	25	26	28	30	32	35	40	50
Piston plug description	Ø16	Ø18	Ø20 to Ø22	Ø24 to Ø26			Ø28	Ø30 to 32	Ø35	Ø40	Ø50		


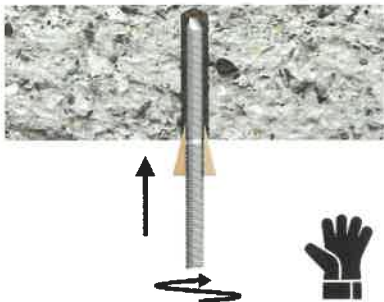

**EVOLUTION II plus / EVO II plus / EVOLUTION 2+ / EV 2+,
EVOLUTION II plus Standard / EVO II plus Standard /
EVOLUTION 2+ (S) / EV 2+ (S) and EVOLUTION II plus Winter /
EVO II plus Winter / EVOLUTION 2+ (W) / EV 2+ (W)**


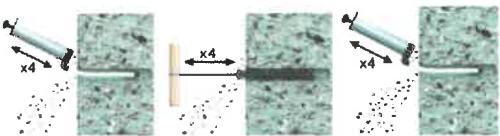
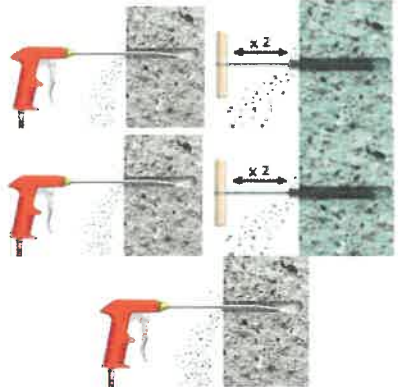





Intended use
Tools (3)

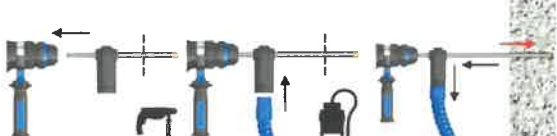





Annex B8
of European
Technical Assessment
ETA-21/0767


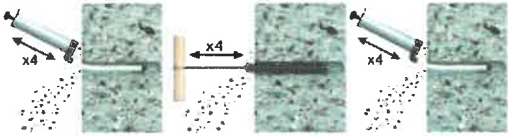
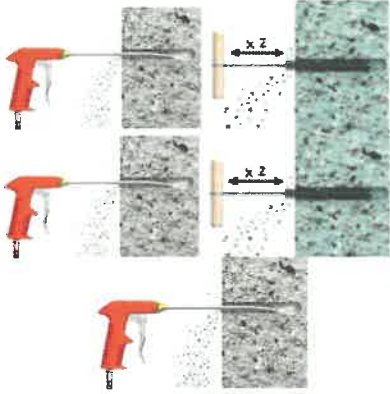




	<p>1. Drill hole to the required diameter and depth using a rotary percussive machine</p>
<p>a.</p>  <p>b.</p> 	<p>2. Hole cleaning.</p> <p>a. Clean the hole with brush and hand pump:</p> <ul style="list-style-type: none"> - starting from the drill hole bottom blow the hole at least 4 times using the hand pump, - using the specified brush, mechanically brush out the hole at least 4 times, - starting from the drill hole bottom, blow at least 4 times with the hand pump. <p>b. Cleaning hole with compressed air:</p> <ul style="list-style-type: none"> - starting from the drill hole bottom blow the hole at least twice by compressed air (6 atm), - using the specified brush, mechanically brush out the hole at least twice, - blow the hole at least twice by compressed air (6atm), - brush out the hole at least twice, - blow over the hole at least twice by compressed air (6atm).
	<p>3. Insert cartridge into dispenser and attach nozzle. Dispense to waste until even colour is obtained (min. 10 cm).</p>
	<p>4. Insert the mixing nozzle to the far end of the hole and inject mortar, slowly withdrawing the nozzle as the hole is filled to 2/3 of its depth.</p>
	<p>5. Immediately insert the stud, slowly and with slight twisting motion. Remove any excess mortar around the hole before it sets.</p>
	<p>6. Leave the fixing undisturbed until the curing time elapses.</p>
	<p>7. Attach fixture and tighten the nut to the required installation torque. The applied installation torque cannot exceed $T_{inst,max}$.</p>
<p>EVOLUTION II plus / EVO II plus / EVOLUTION 2+ / EV 2+, EVOLUTION II plus Standard / EVO II plus Standard / EVOLUTION 2+ (S) / EV 2+ (S) and EVOLUTION II plus Winter / EVO II plus Winter / EVOLUTION 2+ (W) / EV 2+ (W)</p>	
<p>Intended use Installation instruction – threaded rod – standard cleaning</p>	
<p>Annex B9 of European Technical Assessment ETA-21/0767</p>	

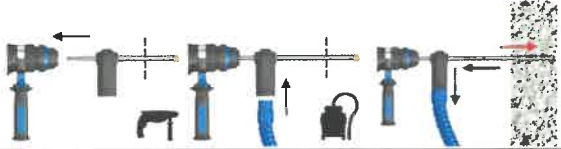




	<p>1. Drill hole to the required diameter and depth using a hollow drill bit with vacuum cleaner.</p>
	<p>2. Insert cartridge into dispenser and attach nozzle. Dispense to waste until even colour is obtained.</p>
	<p>3. Insert the mixing nozzle to the far end of the hole and inject mortar, slowly withdrawing the nozzle as the hole is filled to 2/3 of its depth.</p>
	<p>4. Immediately insert the stud, slowly and with slight twisting motion. Remove any excess mortar around the hole before it sets.</p>
	<p>5. Leave the fixing undisturbed until the curing time elapses.</p>
	<p>6. Attach fixture and tighten the nut to the required installation torque. The applied installation torque cannot exceed $T_{inst,max}$.</p>
<p>EVOLUTION II plus / EVO II plus / EVOLUTION 2+ / EV 2+, EVOLUTION II plus Standard / EVO II plus Standard / EVOLUTION 2+ (S) / EV 2+ (S) and EVOLUTION II plus Winter / EVO II plus Winter / EVOLUTION 2+ (W) / EV 2+ (W)</p>	
<p>Intended use Installation instruction – threaded rod – cleaning with hollow drill bit (special cleaning method)</p>	
<p>Annex B10 of European Technical Assessment ETA-21/0767</p>	

	<p>1. Inject from the bottom of the hole. Inject the mortar about 2/3 of the hole depth. For best performance use extension and appropriately sized piston plug assembled on the mixer.</p>
	<p>2. Drive the stud immediately into the hole. Use temporary interlocking element.</p>
	<p>3. Leave the fixing undisturbed until the curing time elapses. To avoid the slipping of the stud during the open time of the product (due to the stud own weight) use a temporary interlocking element.</p>
<p>EVOLUTION II plus / EVO II plus / EVOLUTION 2+ / EV 2+, EVOLUTION II plus Standard / EVO II plus Standard / EVOLUTION 2+ (S) / EV 2+ (S) and EVOLUTION II plus Winter / EVO II plus Winter / EVOLUTION 2+ (W) / EV 2+ (W)</p>	
<p>Intended use Installation instruction – threaded rod – overhead installation</p>	<p>Annex B11 of European Technical Assessment ETA-21/0767</p>

	<p>1. Drill hole to the required diameter and depth using a rotary percussive machine.</p>
<p>a.</p>  <p>b.</p> 	<p>2. Hole cleaning.</p> <p>a. Clean the hole with brush and hand pump:</p> <ul style="list-style-type: none"> - starting from the drill hole bottom blow the hole at least 4 times using the hand pump, - using the specified brush, mechanically brush out the hole at least 4 times, - starting from the drill hole bottom, blow at least 4 times with the hand pump. <p>b. Cleaning hole with compressed air:</p> <ul style="list-style-type: none"> - starting from the drill hole bottom blow the hole at least twice by compressed air (6 atm), - using the specified brush, mechanically brush out the hole at least twice, - blow the hole at least twice by compressed air (6 atm), - brush out the hole at least twice, - blow over the hole at least twice by compressed air (6 atm).
	<p>3. Insert cartridge into dispenser and attach nozzle. Dispense to waste until even colour is obtained (min. 10 cm).</p>
	<p>4. Insert the mixing nozzle to the far end of the hole and inject mortar, slowly withdrawing the nozzle as the hole is filled to 2/3 of its depth.</p>
	<p>5. Immediately insert the rod with inner thread, slowly and with slight twisting motion. Remove any excess mortar around the hole before it sets.</p>
	<p>6. Leave the fixing undisturbed until the curing time elapses.</p>
	<p>7. Attach fixture and tighten the bolt to the required installation torque. The applied installation torque cannot exceed $T_{inst,max}$.</p>
<p>EVOLUTION II plus / EVO II plus / EVOLUTION 2+ / EV 2+, EVOLUTION II plus Standard / EVO II plus Standard / EVOLUTION 2+ (S) / EV 2+ (S) and EVOLUTION II plus Winter / EVO II plus Winter / EVOLUTION 2+ (W) / EV 2+ (W)</p>	<p>Annex B12 of European Technical Assessment ETA-21/0767</p>
<p>Intended use Installation instruction – anchor rod with inner thread – standard cleaning</p>	

	<p>1. Drill hole to the required diameter and depth using a hollow drill bit with vacuum cleaner.</p>
	<p>2. Insert cartridge into dispenser and attach nozzle. Dispense to waste until even colour is obtained (min. 10 cm).</p>
	<p>3. Insert the mixing nozzle to the far end of the hole and inject mortar, slowly withdrawing the nozzle as the hole is filled to 2/3 of its depth.</p>
	<p>4. Immediately insert the rod with inner thread, slowly and with slight twisting motion. Remove any excess mortar around the hole before it sets.</p>
	<p>5. Leave the fixing undisturbed until the curing time elapses.</p>
	<p>6. Attach fixture and tighten the bolt to the required installation torque. The applied installation torque cannot exceed $T_{inst,max}$.</p>
<p>EVOLUTION II plus / EVO II plus / EVOLUTION 2+ / EV 2+, EVOLUTION II plus Standard / EVO II plus Standard / EVOLUTION 2+ (S) / EV 2+ (S) and EVOLUTION II plus Winter / EVO II plus Winter / EVOLUTION 2+ (W) / EV 2+ (W)</p>	<p>Annex B13 of European Technical Assessment ETA-21/0767</p>
<p>Intended use Installation instruction—anchor rod with inner thread – cleaning with hollow drill bit (special cleaning method)</p>	

	<p>1. Drill hole to the required diameter and depth using a rotary percussive machine.</p>			
<p>a.</p>  <p>b.</p> 	<p>2. Hole cleaning.</p> <p>a. Cleaning hole with brush and hand pump:</p> <ul style="list-style-type: none"> - starting from the drill hole bottom blow the hole at least 4 times using the hand pump, - using the specified brush, mechanically brush out the hole at least 4 times, - starting from the drill hole bottom, blow at least 4 times with the hand pump. <p>b. Cleaning hole with compressed air:</p> <ul style="list-style-type: none"> - starting from the drill hole bottom blow the hole at least twice by compressed air (6 atm), - using the specified brush, mechanically brush out the hole at least twice, - blow the hole at least twice by compressed air (6 atm), - brush out the hole at least twice, - blow over the hole at least twice by compressed air (6 atm). 			
	<p>3. Insert cartridge into dispenser and attach nozzle. Dispense to waste until even colour is obtained (min. 10 cm).</p>			
	<p>4. Insert the mixing nozzle to the far end of the hole and inject mortar, slowly withdrawing the nozzle as the hole is filled to 2/3 of its depth.</p>			
	<p>5. Immediately insert the rebar, slowly and with slight twisting motion. Remove any excess mortar around the hole before it sets.</p>			
	<p>6. Leave the fixing undisturbed until the curing time elapses.</p>			
<table border="1"> <tr> <td data-bbox="181 1749 1078 1872"> <p>EVOLUTION II plus / EVO II plus / EVOLUTION 2+ / EV 2+, EVOLUTION II plus Standard / EVO II plus Standard / EVOLUTION 2+ (S) / EV 2+ (S) and EVOLUTION II plus Winter / EVO II plus Winter / EVOLUTION 2+ (W) / EV 2+ (W)</p> </td><td data-bbox="1078 1749 1374 1991" rowspan="2"> <p>Annex B14 of European Technical Assessment ETA-21/0767</p> </td></tr> <tr> <td data-bbox="181 1872 1078 1991"> <p>Intended use Installation instruction – rebar – standard cleaning</p> </td></tr> </table>		<p>EVOLUTION II plus / EVO II plus / EVOLUTION 2+ / EV 2+, EVOLUTION II plus Standard / EVO II plus Standard / EVOLUTION 2+ (S) / EV 2+ (S) and EVOLUTION II plus Winter / EVO II plus Winter / EVOLUTION 2+ (W) / EV 2+ (W)</p>	<p>Annex B14 of European Technical Assessment ETA-21/0767</p>	<p>Intended use Installation instruction – rebar – standard cleaning</p>
<p>EVOLUTION II plus / EVO II plus / EVOLUTION 2+ / EV 2+, EVOLUTION II plus Standard / EVO II plus Standard / EVOLUTION 2+ (S) / EV 2+ (S) and EVOLUTION II plus Winter / EVO II plus Winter / EVOLUTION 2+ (W) / EV 2+ (W)</p>	<p>Annex B14 of European Technical Assessment ETA-21/0767</p>			
<p>Intended use Installation instruction – rebar – standard cleaning</p>				

	<p>1. Drill hole to the required diameter and depth using a hollow drill bit with vacuum cleaner.</p>
	<p>2. Insert cartridge into dispenser and attach nozzle. Dispense to waste until even colour is obtained (min. 10 cm).</p>
	<p>3. Insert the mixing nozzle to the far end of the hole and inject mortar, slowly withdrawing the nozzle as the hole is filled to 2/3 of its depth.</p>
	<p>4. Immediately insert the rebar, slowly and with slight twisting motion. Remove any excess mortar around the hole before it sets.</p>
	<p>5. Leave the fixing undisturbed until the curing time elapses.</p>
<p>EVOLUTION II plus / EVO II plus / EVOLUTION 2+ / EV 2+, EVOLUTION II plus Standard / EVO II plus Standard / EVOLUTION 2+ (S) / EV 2+ (S) and EVOLUTION II plus Winter / EVO II plus Winter / EVOLUTION 2+ (W) / EV 2+ (W)</p>	
<p>Intended use Installation instruction – rebar – cleaning with hollow drill bit (special cleaning method)</p>	
<p>Annex B15 of European Technical Assessment ETA-21/0767</p>	


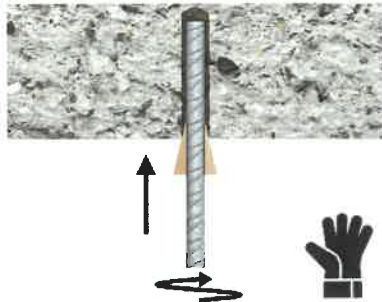
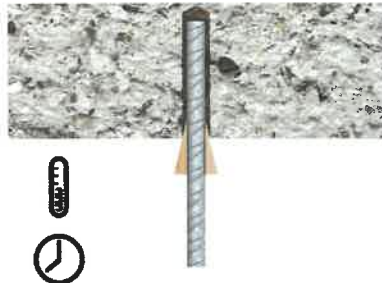
	<p>1. Inject from the bottom of the hole. Inject the mortar about 2/3 of the hole depth. For best performance use extension and appropriately sized piston plug assembled on the mixer.</p>
	<p>2. Drive the rebar immediately into the hole. Use temporary interlocking element.</p>
	<p>3. Leave the fixing undisturbed until the curing time elapses. To avoid the slipping of the rebar during the open time of the product (due to the rebar own weight) use a temporary interlocking element.</p>
<p>EVOLUTION II plus / EVO II plus / EVOLUTION 2+ / EV 2+, EVOLUTION II plus Standard / EVO II plus Standard / EVOLUTION 2+ (S) / EV 2+ (S) and EVOLUTION II plus Winter / EVO II plus Winter / EVOLUTION 2+ (W) / EV 2+ (W)</p>	<p>Annex B16 of European Technical Assessment ETA-21/0767</p>
<p>Intended use Installation instruction – rebar – overhead installation</p>	

Table C1: Characteristic resistance under tension load for threaded rod in uncracked concrete


Size			M8	M10	M12	M16	M20	M24	M30
Steel failure									
Steel failure with threaded rod grade 5.8									
Characteristic resistance	$N_{Rk,s}$	[kN]	18	29	42	78	122	176	280
Partial safety factor ¹⁾	γ_{Ms}	[-]	1,50						
Steel failure with threaded rod grade 8.8									
Characteristic resistance	$N_{Rk,s}$	[kN]	29	46	67	125	196	282	448
Partial safety factor ¹⁾	γ_{Ms}	[-]	1,50						
Steel failure with threaded rod grade 10.9									
Characteristic resistance	$N_{Rk,s}$	[kN]	36	58	84	157	245	353	561
Partial safety factor ¹⁾	γ_{Ms}	[-]	1,40						
Steel failure with threaded rod grade 12.9									
Characteristic resistance	$N_{Rk,s}$	[kN]	43	69	101	188	294	423	673
Partial safety factor ¹⁾	γ_{Ms}	[-]	1,40						
Steel failure with stainless steel threaded rod A4-70									
Characteristic resistance	$N_{Rk,s}$	[kN]	25	40	59	109	171	247	392
Partial safety factor ¹⁾	γ_{Ms}	[-]	1,87						
Steel failure with stainless steel threaded rod A4-80									
Characteristic resistance	$N_{Rk,s}$	[kN]	29	46	67	125	196	282	448
Partial safety factor ¹⁾	γ_{Ms}	[-]	1,60						
Steel failure with high corrosion resistant steel grade 70									
Characteristic resistance	$N_{Rk,s}$	[kN]	25	40	59	109	171	247	392
Partial safety factor ¹⁾	γ_{Ms}	[-]	1,87						
Steel failure with ultra-high strength steel threaded rod grade 14.8									
Characteristic resistance	$N_{Rk,s}$	[kN]	51	81	118	219	343	494	785
Partial safety factor ¹⁾	γ_{Ms}	[-]	1,5						
Steel failure with ultra-high strength steel threaded rod grade 15.8									
Characteristic resistance	$N_{Rk,s}$	[kN]	54	87	126	235	367	529	841
Partial safety factor ¹⁾	γ_{Ms}	[-]	1,5						
Steel failure with ultra-high strength steel threaded rod grade 16.8									
Characteristic resistance	$N_{Rk,s}$	[kN]	58	92	134,9	251	392	564	897
Partial safety factor ¹⁾	γ_{Ms}	[-]	1,5						
Combined pull-out and concrete cone failure in uncracked concrete C20/25 for a working life of 50 years									
Characteristic bond resistance									
Temperature range I: 24°C / 40°C	$\tau_{Rk,ucr,50}$	[N/mm ²]	16,0	15,0	15,0	13,0	10,0	10,0	8,0
Temperature range II: 50°C / 80°C	$\tau_{Rk,ucr,50}$	[N/mm ²]	16,0	15,0	15,0	13,0	10,0	10,0	8,0
Temperature range III: 80°C / 120°C	$\tau_{Rk,ucr,50}$	[N/mm ²]	8,5	8,0	8,0	7,0	5,5	5,5	4,5
Increasing factor	ψ_c	C30/37	1,04						
		C40/50	1,07						
		C50/60	1,09						
Sustained load factor	ψ_{sus}^0	24°C / 40°C	0,72						
		50°C / 80°C	0,72						
		80°C / 120°C	0,61						
Combined pull-out and concrete cone failure in uncracked concrete C20/25 for a working life of 100 years									
Characteristic bond resistance									
Temperature range I: 24°C / 40°C	$\tau_{Rk,ucr,100}$	[N/mm ²]	15,0	15,0	14,0	13,0	10,0	9,5	8,0
Temperature range II: 50°C / 80°C	$\tau_{Rk,ucr,100}$	[N/mm ²]	15,0	15,0	14,0	13,0	10,0	9,5	8,0
Increasing factor	ψ_c	C30/37	1,04						
		C40/50	1,07						
		C50/60	1,09						

**EVOLUTION II plus / EVO II plus / EVOLUTION 2+ / EV 2+,
EVOLUTION II plus Standard / EVO II plus Standard /
EVOLUTION 2+ (S) / EV 2+ (S) and EVOLUTION II plus Winter /
EVO II plus Winter / EVOLUTION 2+ (W) / EV 2+ (W)**

Characteristic resistance under tension loads for threaded rod
in uncracked concrete

Annex C1
of European
Technical Assessment
ETA-21/0767

Table C1 (continuation)

Size			M8	M10	M12	M16	M20	M24	M30
Concrete cone failure in uncracked concrete									
Factor for uncracked concrete		$k_{ucr,N}$	[-]		11,0				
Edge distance		$c_{ucr,N}$	[mm]		$1,5 \cdot h_{ef}$				
Spacing		$s_{ucr,N}$	[mm]		$3,0 \cdot h_{ef}$				
Splitting failure									
Edge distance		$c_{cr,sp}$ for h_{min}	[mm]	$2,0 \cdot h_{ef}$				$1,5 \cdot h_{ef}$	
		$c_{cr,sp}$ for $h_{min} < h^{2)} < 2 \cdot h_{ef}$ ($c_{cr,sp}$ from linear interpolation)							
		$c_{cr,sp}$ for $h^{2)} \geq 2 \cdot h_{ef}$		$c_{cr,N}$					
Spacing		$s_{cr,sp}$	[mm]		$2,0 \cdot c_{cr,sp}$				
Installation safety factor for combined pull-out, concrete cone and splitting failure									
Installation safety factors for in use category I1	standard cleaning	γ_{inst}	[-]	1,0					
	special cleaning			1,2	1,0				1,2
Installation safety factors for in use category I2	standard cleaning			1,0					
	special cleaning			1,2	1,0				1,2

¹⁾ In the absence of other national regulation.

²⁾ h – concrete member thickness.

**EVOLUTION II plus / EVO II plus / EVOLUTION 2+ / EV 2+,
EVOLUTION II plus Standard / EVO II plus Standard /
EVOLUTION 2+ (S) / EV 2+ (S) and EVOLUTION II plus Winter /
EVO II plus Winter / EVOLUTION 2+ (W) / EV 2+ (W)**

Characteristic resistance under tension loads for threaded rod
in uncracked concrete

Annex C2
of European
Technical Assessment
ETA-21/0767

Table C2: Characteristic resistance under tension loads for threaded rod in cracked concrete


Size			M8	M10	M12	M16	M20	M24	M30
Steel failure									
Steel failure with threaded rod grade 5.8									
Characteristic resistance	N _{Rk,s}	[kN]	18	29	42	78	122	176	280
Partial safety factor ¹⁾	γ _{Ms}	[-]	1,50						
Steel failure with threaded rod grade 8.8									
Characteristic resistance	N _{Rk,s}	[kN]	29	46	67	125	196	282	448
Partial safety factor ¹⁾	γ _{Ms}	[-]	1,50						
Steel failure with threaded rod grade 10.9									
Characteristic resistance	N _{Rk,s}	[kN]	36	58	84	157	245	353	561
Partial safety factor ¹⁾	γ _{Ms}	[-]	1,40						
Steel failure with threaded rod grade 12.9									
Characteristic resistance	N _{Rk,s}	[kN]	43	69	101	188	294	423	673
Partial safety factor ¹⁾	γ _{Ms}	[-]	1,40						
Steel failure with stainless steel threaded rod A4-70									
Characteristic resistance	N _{Rk,s}	[kN]	25	40	59	109	171	247	392
Partial safety factor ¹⁾	γ _{Ms}	[-]	1,87						
Steel failure with stainless steel threaded rod A4-80									
Characteristic resistance	N _{Rk,s}	[kN]	29	46	67	125	196	282	448
Partial safety factor ¹⁾	γ _{Ms}	[-]	1,60						
Steel failure with high corrosion resistant steel grade 70									
Characteristic resistance	N _{Rk,s}	[kN]	25	40	59	109	171	247	392
Partial safety factor ¹⁾	γ _{Ms}	[-]	1,87						
Steel failure with ultra-high strength steel threaded rod grade 14.8									
Characteristic resistance	N _{Rk,s}	[kN]	51	81	118	219	343	494	785
Partial safety factor ¹⁾	γ _{Ms}	[-]	1,5						
Steel failure with ultra-high strength steel threaded rod grade 15.8									
Characteristic resistance	N _{Rk,s}	[kN]	54	87	126	235	367	529	841
Partial safety factor ¹⁾	γ _{Ms}	[-]	1,5						
Steel failure with ultra-high strength steel threaded rod grade 16.8									
Characteristic resistance	N _{Rk,s}	[kN]	58	92	134,9	251	392	564	897
Partial safety factor ¹⁾	γ _{Ms}	[-]	1,5						
Combined pull-out and concrete cone failure in cracked concrete C20/25 for a working life of 50 years									
Characteristic bond resistance									
Temperature range I: 24°C / 40°C	τ _{Rk,cr,50}	[N/mm ²]	10,0	11,0	11,0	9,5	7,5	7,0	5,0
Temperature range II: 50°C / 80°C	τ _{Rk,cr,50}	[N/mm ²]	10,0	11,0	11,0	9,5	7,5	7,0	5,0
Temperature range III: 80°C / 120°C	τ _{Rk,cr,50}	[N/mm ²]	5,0	6,0	6,0	5,0	4,0	4,0	3,0
Increasing factor	ψ _c	C30/37	1,04						
		C40/50	1,07						
		C50/60	1,09						
Sustained load factor	ψ ⁰ _{slur}	24°C / 40°C	0,72						
		50°C / 80°C	0,72						
		80°C / 120°C	0,61						
Combined pull-out and concrete cone failure in cracked concrete C20/25 for a working life of 100 years									
Characteristic bond resistance									
Temperature range I: 24°C / 40°C	τ _{Rk,ucr,100}	[N/mm ²]	9,5	10,0	10,5	9,5	7,5	7,0	5,0
Temperature range II: 50°C / 80°C	τ _{Rk,ucr,100}	[N/mm ²]	9,5	10,0	10,5	9,5	7,5	7,0	5,0
Increasing factor	ψ _c	C30/37	1,04						
		C40/50	1,07						
		C50/60	1,09						

**EVOLUTION II plus / EVO II plus / EVOLUTION 2+ / EV 2+,
EVOLUTION II plus Standard / EVO II plus Standard /
EVOLUTION 2+ (S) / EV 2+ (S) and EVOLUTION II plus Winter /
EVO II plus Winter / EVOLUTION 2+ (W) / EV 2+ (W)**

Characteristic resistance under tension loads for threaded rod
in cracked concrete

Annex C3
of European
Technical Assessment
ETA-21/0767

Table C2 (continuation)

Size			M8	M10	M12	M16	M20	M24	M30
Concrete cone failure in cracked concrete									
Factor for cracked concrete	$k_{cr,N}$	[-]	7,7						
Edge distance	$c_{cr,N}$	[mm]	$1,5 \cdot h_{ef}$						
Spacing	$s_{cr,N}$	[mm]	$3,0 \cdot h_{ef}$						
Splitting failure									
Edge distance	$c_{cr,sp}$ for h_{min}	[mm]	$2,0 \cdot h_{ef}$					$1,5 \cdot h_{ef}$	
	$c_{cr,sp}$ for $h_{min} < h^2) < 2 \cdot h_{ef}$ ($c_{cr,sp}$ from linear interpolation)								
	$c_{cr,sp}$ for $h^2) \geq 2 \cdot h_{ef}$		$c_{cr,N}$						
Spacing	$s_{cr,sp}$	[mm]	$2,0 \cdot c_{cr,sp}$						
Installation safety factor for combined pull-out, concrete cone and splitting failure									
Installation safety factors for in use category I1	standard cleaning	γ_{inst}	[-]	1,0					
	special cleaning			1,2	1,0				1,2
Installation safety factors for in use category I2	standard cleaning			1,0					
	special cleaning			1,2	1,0				1,2

¹⁾ In the absence of other national regulation.

²⁾ h – concrete member thickness.

EVOLUTION II plus / EVO II plus / EVOLUTION 2+ / EV 2+,
EVOLUTION II plus Standard / EVO II plus Standard /
EVOLUTION 2+ (S) / EV 2+ (S) and EVOLUTION II plus Winter /
EVO II plus Winter / EVOLUTION 2+ (W) / EV 2+ (W)

Characteristic resistance under tension loads for threaded rod
in cracked concrete

Annex C4
of European
Technical Assessment
ETA-21/0767

Table C3: Characteristic resistance under tension load for rod with inner thread in uncracked concrete


Size			M6 Ø10	M8/ Ø12	M10/ Ø16	M12/ Ø16	M16/ Ø24	
Steel failure								
Steel failure with rod with inner thread grade 5.8								
Characteristic resistance	N _{Rk,s}	[kN]	10	18	29	42	78	
Partial safety factor ¹⁾	γ _{Ms}	[-]	1,50					
Steel failure with rod with inner thread grade 8.8								
Characteristic resistance	N _{Rk,s}	[kN]	16	29	46	67	125	
Partial safety factor ¹⁾	γ _{Ms}	[-]	1,50					
Steel failure with stainless steel rod with inner thread threaded rod A4-70								
Characteristic resistance	N _{Rk,s}	[kN]	14	25	40	59	109	
Partial safety factor ¹⁾	γ _{Ms}	[-]	1,87					
Steel failure with stainless steel rod with inner thread A4-80								
Characteristic resistance	N _{Rk,s}	[kN]	16	29	46	67	125	
Partial safety factor ¹⁾	γ _{Ms}	[-]	1,60					
Steel failure with high corrosion resistant steel grade 70								
Characteristic resistance	N _{Rk,s}	[kN]	14	25	40	59	109	
Partial safety factor ¹⁾	γ _{Ms}	[-]	1,87					
Combined pull-out and concrete cone failure in uncracked concrete C20/25 for a working life of 50 years								
Temperature range I: 24°C / 40°C	τ _{Rk,ucr,50}	[N/mm ²]	11,0	14,0	11,0	11,0	8,0	
Temperature range II: 50°C / 80°C	τ _{Rk,ucr,50}	[N/mm ²]	11,0	14,0	11,0	11,0	8,0	
Temperature range III: 80°C / 120°C	τ _{Rk,ucr,50}	[N/mm ²]	6,0	7,0	6,0	6,0	4,0	
Increasing factor	ψ _c	C30/37	1,04					1,00
		C40/50	1,07					1,00
		C50/60	1,09					1,00
Sustained load factor	ψ ⁰ _{sls}	24°C/40°C	0,72					
		50°C/80°C	0,72					
		80°C / 120°C	0,61					
Combined pull-out and concrete cone failure in uncracked concrete C20/25 for a working life of 100 years								
Temperature range I: 24°C / 40°C	τ _{Rk,ucr,100}	[N/mm ²]	10,0	13,0	10,0	11,0	8,0	
Temperature range II: 50°C / 80°C	τ _{Rk,ucr,100}	[N/mm ²]	10,0	13,0	10,0	11,0	8,0	
Increasing factor	ψ _c	C30/37	1,04					1,00
		C40/50	1,07					1,00
		C50/60	1,09					1,00

EVOLUTION II plus / EVO II plus / EVOLUTION 2+ / EV 2+,
 EVOLUTION II plus Standard / EVO II plus Standard /
 EVOLUTION 2+ (S) / EV 2+ (S) and EVOLUTION II plus Winter /
 EVO II plus Winter / EVOLUTION 2+ (W) / EV 2+ (W)

Characteristic resistance under tension loads for rod with inner thread
 in uncracked concrete

Annex C5
 of European
 Technical Assessment
 ETA-21/0767

Table C3: (continuation)

Resistance to concrete cone failure in uncracked concrete				
Factor for ucracked concrete		$k_{ucr,N}$	[-]	11,0
Edge distance		$c_{ucr,N}$	[mm]	$1,5 \cdot h_{ef}$
Spacing		$s_{ucr,N}$	[mm]	$3,0 \cdot h_{ef}$
Splitting failure				
Edge distance	$c_{cr,sp}$ for h_{min}	[mm]	$2,0 \cdot h_{ef}$	$1,5 \cdot h_{ef}$
	$c_{cr,sp}$ for $h_{min} < h^{2)} < 2 \cdot h_{ef}$ ($c_{cr,sp}$ from linear interpolation)			
	$c_{cr,sp}$ for $h^{2)} \geq 2 \cdot h_{ef}$		$c_{cr,N}$	
Spacing		$s_{cr,sp}$	[mm]	$2,0 \cdot c_{cr,sp}$
Installation safety factor for combined pull-out, concrete cone and splitting failure				
Installation safety factors for use category I1 ¹⁾	standard cleaning	γ_{inst}	[-]	1,0
	special cleaning			1,0
Installation safety factors for use category I2 ¹⁾	standard cleaning			1,0
	special cleaning			1,0

¹⁾ In the absence of other national regulation.²⁾ h – concrete member thickness.

**EVOLUTION II plus / EVO II plus / EVOLUTION 2+ / EV 2+,
EVOLUTION II plus Standard / EVO II plus Standard /
EVOLUTION 2+ (S) / EV 2+ (S) and EVOLUTION II plus Winter /
EVO II plus Winter / EVOLUTION 2+ (W) / EV 2+ (W)**

Characteristic resistance under tension loads for rod with inner thread
in uncracked concrete

Annex C5
of European
Technical Assessment
ETA-21/0767

Table C4: Characteristic resistance under tension loads for rod with inner thread in cracked concrete


Size			M6 /Ø10	M8/ Ø12	M10/ Ø16	M12/ Ø16	M16/ Ø24
Steel failure							
Steel failure with rod with inner thread grade 5.8							
Characteristic resistance	$N_{Rk,s}$	[kN]	10	18	29	42	78
Partial safety factor ¹⁾	γ_{Ms}	[-]	1,50				
Steel failure with rod with inner thread grade 8.8							
Characteristic resistance	$N_{Rk,s}$	[kN]	16	29	46	67	125
Partial safety factor ¹⁾	γ_{Ms}	[-]	1,50				
Steel failure with stainless steel rod with inner thread A4-70							
Characteristic resistance	$N_{Rk,s}$	[kN]	14	25	40	59	109
Partial safety factor ¹⁾	γ_{Ms}	[-]	1,87				
Steel failure with stainless steel rod with inner thread rod A4-80							
Characteristic resistance	$N_{Rk,s}$	[kN]	16	29	46	67	125
Partial safety factor ¹⁾	γ_{Ms}	[-]	1,60				
Steel failure with high corrosion resistant steel grade 70							
Characteristic resistance	$N_{Rk,s}$	[kN]	14	25	40	59	109
Partial safety factor ¹⁾	γ_{Ms}	[-]	1,87				
Combined pull-out and concrete cone failure in cracked concrete C20/25 for a working life of 50 years							
Temperature range I: 24°C / 40°C	$\tau_{Rk,cr,50}$	[N/mm ²]	10,0	10,0	9,5	9,0	4,0
Temperature range II: 50°C / 80°C	$\tau_{Rk,cr,50}$	[N/mm ²]	10,0	10,0	9,5	9,0	4,0
Temperature range III: 80°C / 120°C	$\tau_{Rk,cr,50}$	[N/mm ²]	5,0	6,0	5,0	5,0	2,0
Increasing factor	ψ_c	C30/37	1,04				1,00
		C40/50	1,07				1,00
		C50/60	1,09				1,00
Sustained load factor	ψ_{sus}^0	24°C/40°C	0,72				
		50°C/80°C	0,72				
		80°C / 120°C	0,61				
Combined pull-out and concrete cone failure in cracked concrete C20/25 for a working life of 100 years							
Temperature range I: 24°C / 40°C	$\tau_{Rk,cr,100}$	[N/mm ²]	7,0	9,5	9,0	8,5	4,0
Temperature range II: 50°C / 80°C	$\tau_{Rk,cr,100}$	[N/mm ²]	7,0	9,5	9,0	8,5	4,0
Increasing factor	ψ_c	C30/37	1,04				1,00
		C40/50	1,07				1,00
		C50/60	1,09				1,00

**EVOLUTION II plus / EVO II plus / EVOLUTION 2+ / EV 2+,
EVOLUTION II plus Standard / EVO II plus Standard /
EVOLUTION 2+ (S) / EV 2+ (S) and EVOLUTION II plus Winter /
EVO II plus Winter / EVOLUTION 2+ (W) / EV 2+ (W)**

Characteristic resistance under tension loads for rod with inner thread
in cracked concrete

Annex C6
of European
Technical Assessment
ETA-21/0767

Table C4: (continuation)

Cone failure in cracked concrete				
Factor for cracked concrete	$k_{cr,N}$	[-]	7,7	
Edge distance	$C_{cr,N}$	[mm]	$1,5 \cdot h_{ef}$	
Spacing	$S_{cr,N}$	[mm]	$3,0 \cdot h_{ef}$	
Splitting failure				
Edge distance	$C_{cr,sp}$ for h_{min}	[mm]	$2,0 \cdot h_{ef}$	$1,5 \cdot h_{ef}$
	$C_{cr,sp}$ for $h_{min} < h^2) < 2 \cdot h_{ef}$ ($C_{cr,sp}$ from linear interpolation)			
	$C_{cr,sp}$ for $h^2) \geq 2 \cdot h_{ef}$		$C_{cr,N}$	
Spacing	$S_{cr,sp}$	[mm]	$2,0 \cdot C_{cr,sp}$	
Installation safety factor for combined pull-out, concrete cone and splitting failure				
Installation safety factors for use category I1	standard cleaning	γ_{inst}	[-]	1,0
	special cleaning			1,0
Installation safety factors for use category I2	standard cleaning			1,0
	special cleaning			1,0

¹⁾ In the absence of other national regulation.


²⁾ h – concrete member thickness.

**EVOLUTION II plus / EVO II plus / EVOLUTION 2+ / EV 2+,
EVOLUTION II plus Standard / EVO II plus Standard /
EVOLUTION 2+ (S) / EV 2+ (S) and EVOLUTION II plus Winter /
EVO II plus Winter / EVOLUTION 2+ (W) / EV 2+ (W)**

Characteristic resistance under tension loads for rod with inner thread
in cracked concrete

Annex C6
of European
Technical Assessment
ETA-21/0767

Table C5: Characteristic resistance under tension load for rebar in uncracked concrete

Size			Ø8	Ø10	Ø12	Ø14	Ø16	Ø20	Ø25	Ø32
Steel failure with rebar										
Characteristic resistance	$N_{Rk,s}$	[kN]	$A_s^{3)} \cdot f_{yk}^{4)}$							
Partial safety factor ¹⁾	γ_{Ms}	[-]	1,40							
Combined pull-out and concrete cone failure in uncracked concrete C20/25 for a working life of 50 years										
Temperature range I: 24°C / 40°C	$\tau_{Rk,ucr,50}$	[N/mm ²]	13,0	14,0	14,0	13,0	13,0	10,0	9,0	7,5
Temperature range II: 50°C / 80°C	$\tau_{Rk,ucr,50}$	[N/mm ²]	13,0	14,0	14,0	13,0	13,0	10,0	9,0	7,5
Temperature range III: 80°C / 120°C	$\tau_{Rk,ucr,50}$	[N/mm ²]	7,0	7,0	7,0	7,0	7,0	5,5	5,0	4,0
Increasing factor	ψ_c	C30/37	1,04							
		C40/50	1,07							
		C50/60	1,09							
Sustained load factor	ψ_{sust}^{ρ}	24°C/40°C	0,72							
		50°C/80°C	0,72							
		80°C / 120°C	0,61							
Combined pull-out and concrete cone failure in uncracked concrete C20/25 for a working life of 100 years										
Temperature range I: 24°C / 40°C	$\tau_{Rk,ucr,100}$	[N/mm ²]	12,0	14,0	14,0	12,0	12,0	10,0	8,5	7,5
Temperature range II: 50°C / 80°C	$\tau_{Rk,ucr,100}$	[N/mm ²]	12,0	14,0	14,0	12,0	12,0	10,0	8,5	7,5
Increasing factor	ψ_c	C30/37	1,04							
		C40/50	1,07							
		C50/60	1,09							
Concrete cone failure in uncracked concrete										
Factor for non-cracked concrete	$k_{ucr,N}$	[-]	11,0							
Edge distance	$c_{ucr,N}$	[mm]	$1,5 \cdot h_{ef}$							
Spacing	$s_{ucr,N}$	[mm]	$3,0 \cdot h_{ef}$							
Splitting failure										
Edge distance	$c_{cr,sp}$ for h_{min}	[mm]	$2,0 \cdot h_{ef}$					$1,5 \cdot h_{ef}$		
	$c_{cr,sp}$ for $h_{min} < h^{2)} < 2 \cdot h_{ef}$ ($c_{cr,sp}$ from linear interpolation)									
	$c_{cr,sp}$ for $h^{2)} \geq 2 \cdot h_{ef}$		$c_{cr,N}$							
Spacing	$s_{cr,sp}$	[mm]	$2,0 \cdot c_{cr,sp}$							
Installation safety factor for combined pull-out, concrete cone and splitting failure										
Installation safety factors for use category I1	standard cleaning	γ_{inst}	[-]	1,0						
	special cleaning			1,2	1,0					1,2
Installation safety factors for use category I2	standard cleaning			1,2						
	special cleaning			1,2	1,0					1,2

¹⁾ In the absence of other national regulation.

²⁾ h – concrete member thickness.

³⁾ Stressed cross section of the steel.


⁴⁾ Acc. to EN 1992-1-1.

**EVOLUTION II plus / EVO II plus / EVOLUTION 2+ / EV 2+,
EVOLUTION II plus Standard / EVO II plus Standard /
EVOLUTION 2+ (S) / EV 2+ (S) and EVOLUTION II plus Winter /
EVO II plus Winter / EVOLUTION 2+ (W) / EV 2+ (W)**

Characteristic resistance under tension loads for rebar
in non-cracked concrete

Annex C7
of European
Technical Assessment
ETA-21/0767

Table C6: Characteristic resistance under tension loads for rebar in cracked concrete

Size			Ø8	Ø10	Ø12	Ø14	Ø16	Ø20	Ø25	Ø32
Steel failure with rebar										
Characteristic resistance	$N_{Rk,s}$	[kN]	$A_s^{3)} \cdot f_{uk}^{4)}$							
Partial safety factor ¹⁾	γ_{Ms}	[-]	1,40							
Combined pull-out and concrete cone failure in cracked concrete C20/25 for a working life of 50 years										
Temperature range I: 24°C / 40°C	$\tau_{Rk,cr,50}$	[N/mm ²]	8	9	10	10	8,5	7,5	6	3,5
Temperature range II: 50°C / 80°C	$\tau_{Rk,cr,50}$	[N/mm ²]	8	9	10	10	8,5	7,5	6	3,5
Temperature range III: 80°C / 120°C	$\tau_{Rk,cr,50}$	[N/mm ²]	4,5	5	5	5	4,5	4	3	2
Increasing factor	ψ_c	C30/37	1,04							
		C40/50	1,07							
		C50/60	1,09							
Sustained load factor	ψ_{stat}^0	24°C/40°C	0,72							
		50°C/80°C	0,72							
		80°C / 120°C	0,61							
Combined pull-out and concrete cone failure in non-cracked concrete C20/25 for a working life of 100 years										
Temperature range I: 24°C / 40°C	$\tau_{Rk,cr,100}$	[N/mm ²]	7,5	9	10	10	8,5	7,5	6	3,5
Temperature range II: 50°C / 80°C	$\tau_{Rk,cr,100}$	[N/mm ²]	7,5	9	10	10	8,5	7,5	6	3,5
Increasing factor	ψ_c	C30/37	1,04							
		C40/50	1,07							
		C50/60	1,09							
Concrete cone failure in cracked concrete										
Factor for raked concrete	$k_{cr,N}$	[-]	7,7							
Edge distance	$c_{cr,N}$	[mm]	$1,5 \cdot h_{ef}$							
Spacing	$s_{cr,N}$	[mm]	$3,0 \cdot h_{ef}$							
Splitting failure										
Edge distance	$c_{cr,sp}$ for h_{min}	[mm]	$2,0 \cdot h_{ef}$						$1,5 \cdot h_{ef}$	
	$c_{cr,sp}$ for $h_{min} < h^{2)} < 2 \cdot h_{ef}$ ($c_{cr,sp}$ from linear interpolation)									
	$c_{cr,sp}$ for $h^{2)} \geq 2 \cdot h_{ef}$		$c_{cr,N}$							
Spacing	$s_{cr,sp}$	[mm]	$2,0 \cdot c_{cr,sp}$							
Installation safety factor for combined pull-out, concrete cone and splitting failure										
Installation safety factors for use category I1 ¹⁾	standard cleaning	γ_{inst}	[-]	1,0						
	special cleaning			1,2	1,0					1,2
Installation safety factors for use category I2 ¹⁾	standard cleaning			1,2						
	special cleaning			1,2	1,0					1,2

¹⁾ In the absence of other national regulation.²⁾ h – concrete member thickness.³⁾ Stressed cross section of the steel.⁴⁾ Acc. to EN 1992-1-1.

**EVOLUTION II plus / EVO II plus / EVOLUTION 2+ / EV 2+,
EVOLUTION II plus Standard / EVO II plus Standard /
EVOLUTION 2+ (S) / EV 2+ (S) and EVOLUTION II plus Winter /
EVO II plus Winter / EVOLUTION 2+ (W) / EV 2+ (W)**

Characteristic resistance under tension loads for rebar
in cracked concrete

Annex C8
of European
Technical Assessment
ETA-21/0767

Table C7: Characteristic resistance under shear loads for threaded rod – steel failure without lever arm

Size			M8	M10	M12	M16	M20	M24	M30
Steel failure with threaded rod grade 5.8									
Characteristic resistance	$V_{Rk,s}$	[kN]	9	14	21	39	61	88	140
Factor considering ductility	k_7	[-]				0,8			
Partial safety factor ¹⁾	γ_{Ms}	[-]				1,25			
Steel failure with threaded rod grade 8.8									
Characteristic resistance	$V_{Rk,s}$	[kN]	15	23	34	63	98	141	224
Factor considering ductility	k_7	[-]				0,8			
Partial safety factor ¹⁾	γ_{Ms}	[-]				1,25			
Steel failure with threaded rod grade 10.9									
Characteristic resistance	$V_{Rk,s}$	[kN]	18	29	42	78	122	176	280
Factor considering ductility	k_7	[-]				0,8			
Partial safety factor ¹⁾	γ_{Ms}	[-]				1,50			
Steel failure with threaded rod grade 12.9									
Characteristic resistance	$V_{Rk,s}$	[kN]	22	35	51	94	147	212	336
Factor considering ductility	k_7	[-]				0,8			
Partial safety factor ¹⁾	γ_{Ms}	[-]				1,50			
Steel failure with stainless steel threaded rod A4-70									
Characteristic resistance	$V_{Rk,s}$	[kN]	13	20	29	55	86	124	196
Factor considering ductility	k_7	[-]				0,8			
Partial safety factor ¹⁾	γ_{Ms}	[-]				1,56			
Steel failure with stainless steel threaded rod A4-80									
Characteristic resistance	$V_{Rk,s}$	[kN]	15	23	34	63	98	141	224
Factor considering ductility	k_7	[-]				0,8			
Partial safety factor ¹⁾	γ_{Ms}	[-]				1,33			
Steel failure with high corrosion stainless steel grade 70									
Characteristic resistance	$V_{Rk,s}$	[kN]	13	20	29	55	86	124	196
Factor considering ductility	k_7	[-]				0,8			
Partial safety factor ¹⁾	γ_{Ms}	[-]				1,56			
Steel failure with ultra-high strength steel threaded rod grade 14.8									
Characteristic resistance	$V_{Rk,s}$	[kN]	25	40	59	109	171	247	392
Factor considering ductility	k_7	[-]				0,8			
Partial safety factor ¹⁾	γ_{Ms}	[-]				1,50			
Steel failure with ultra-high strength steel threaded rod grade 15.8									
Characteristic resistance	$V_{Rk,s}$	[kN]	27	43	63	117	183	264	420
Factor considering ductility	k_7	[-]				0,8			
Partial safety factor ¹⁾	γ_{Ms}	[-]				1,50			
Steel failure with ultra-high strength steel threaded rod grade 16.8									
Characteristic resistance	$V_{Rk,s}$	[kN]	29	46	67	125	196	282	448
Factor considering ductility	k_7	[-]				0,8			
Partial safety factor ¹⁾	γ_{Ms}	[-]				1,50			

¹⁾ In the absence of other national regulation.

**EVOLUTION II plus / EVO II plus / EVOLUTION 2+ / EV 2+,
EVOLUTION II plus Standard / EVO II plus Standard /
EVOLUTION 2+ (S) / EV 2+ (S) and EVOLUTION II plus Winter /
EVO II plus Winter / EVOLUTION 2+ (W) / EV 2+ (W)**

Characteristic resistance under shear loads for threaded rod
in cracked and non-cracked concrete

Annex C9
of European
Technical Assessment
ETA-21/0767

Table C8: Characteristic resistance under shear loads for threaded rod – steel failure with lever arm

Size			M8	M10	M12	M16	M20	M24	M30
Steel failure with threaded rod grade 5.8									
Characteristic resistance	$M_{Rk,s}^0$	[Nm]	19	37	65	166	324	561	1124
Partial safety factor ¹⁾	γ_{Ms}	[-]	1,25						
Steel failure with threaded rod grade 8.8									
Characteristic resistance	$M_{Rk,s}^0$	[Nm]	30	60	105	266	519	898	1799
Partial safety factor ¹⁾	γ_{Ms}	[-]	1,25						
Steel failure with threaded rod grade 10.9									
Characteristic resistance	$M_{Rk,s}^0$	[Nm]	37	75	131	333	649	1123	2249
Partial safety factor ¹⁾	γ_{Ms}	[-]	1,50						
Steel failure with threaded rod grade 12.9									
Characteristic resistance	$M_{Rk,s}^0$	[Nm]	45	90	157	400	779	1347	2698
Partial safety factor ¹⁾	γ_{Ms}	[-]	1,50						
Steel failure with stainless steel threaded rod A4-70									
Characteristic resistance	$M_{Rk,s}^0$	[Nm]	26	52	92	233	454	786	1574
Partial safety factor ¹⁾	γ_{Ms}	[-]	1,56						
Steel failure with stainless steel threaded rod A4-80									
Characteristic resistance	$M_{Rk,s}^0$	[Nm]	30	60	105	266	519	898	1799
Partial safety factor ¹⁾	γ_{Ms}	[-]	1,33						
Steel failure with high corrosion resistant steel grade 70									
Characteristic resistance	$M_{Rk,s}^0$	[Nm]	26	52	92	233	454	786	1574
Partial safety factor ¹⁾	γ_{Ms}	[-]	1,56						
Steel failure with ultra-high strength steel threaded rod grade 14.8									
Characteristic resistance	$M_{Rk,s}^0$	[Nm]	52	104	183	466	908	1571	3148
Partial safety factor ¹⁾	γ_{Ms}	[-]	1,50						
Steel failure with ultra-high strength steel threaded rod grade 15.8									
Characteristic resistance	$M_{Rk,s}^0$	[Nm]	56	112	196	499	973	1683	3373
Partial safety factor ¹⁾	γ_{Ms}	[-]	1,50						
Steel failure with ultra-high strength steel threaded rod grade 16.8									
Characteristic resistance	$M_{Rk,s}^0$	[Nm]	59	119	209	532	1038	1796	3598
Partial safety factor ¹⁾	γ_{Ms}	[-]	1,50						

¹⁾ In the absence of other national regulation.

Table C9: Characteristic resistance under shear loads – pry out and concrete edge failure for threaded rod

Size			M8	M10	M12	M16	M20	M24	M30	
Pry out failure										
Pry out factor	k_8	[-]	2							
Concrete edge failure										
Outside diameter of anchor	d_{nom}	[mm]	8	10	12	16	20	24	30	
Effective length of anchor under shear loading	l_f	[mm]	$l_f = h_{ef}$ and $\leq 12 d_{nom}$							$l_f = h_{ef}$ and $\leq \max(8 \cdot d_{nom}; 300 \text{ mm})$

**EVOLUTION II plus / EVO II plus / EVOLUTION 2+ / EV 2+,
EVOLUTION II plus Standard / EVO II plus Standard /
EVOLUTION 2+ (S) / EV 2+ (S) and EVOLUTION II plus Winter /
EVO II plus Winter / EVOLUTION 2+ (W) / EV 2+ (W)**

Characteristic resistance under shear loads for threaded rod
in cracked and non-cracked concrete

Annex C10
of European
Technical Assessment
ETA-21/0767

Table C10: Characteristic resistance under shear loads for rod with inner thread – steel failure without lever arm

Size			M6/Ø10	M8/Ø12	M10/Ø16	M12/Ø16	M16/Ø24
Steel failure with rod with inner thread grade 5.8							
Characteristic resistance	$V_{Rk,s}$	[kN]	5,0	9,2	14,5	21,1	39,3
Factor considering ductility	k_7	[-]			0,8		
Partial safety factor ¹⁾	γ_{Ms}	[-]			1,25		
Steel failure with rod with inner thread grade 8.8							
Characteristic resistance	$V_{Rk,s}$	[kN]	8,0	14,6	23,2	33,7	62,8
Factor considering ductility	k_7	[-]	0,8				
Partial safety factor ¹⁾	γ_{Ms}	[-]			1,25		
Steel failure with stainless steel for rod with inner thread A4-70							
Characteristic resistance	$V_{Rk,s}$	[kN]	7,0	12,8	20,3	29,5	55,0
Factor considering ductility	k_7	[-]			0,8		
Partial safety factor ¹⁾	γ_{Ms}	[-]			1,56		
Steel failure with stainless steel for rod with inner thread A4-80							
Characteristic resistance	$V_{Rk,s}$	[kN]	8,0	14,6	23,2	33,7	62,8
Factor considering ductility	k_7	[-]			0,8		
Partial safety factor ¹⁾	γ_{Ms}	[-]			1,33		
Steel failure with high corrosion stainless steel grade 70							
Characteristic resistance	$V_{Rk,s}$	[kN]	7,0	12,8	20,3	29,5	55,0
Factor considering ductility	k_7	[-]			0,8		
Partial safety factor ¹⁾	γ_{Ms}	[-]			1,56		

¹⁾ In the absence of other national regulation.

Table C11: Characteristic resistance under shear loads for rod with inner thread - steel failure with lever arm

Size			M6/Ø10	M8/Ø12	M10/Ø16	M12/Ø16	M16/Ø24
Steel failure with rod with inner thread grade 5.8							
Characteristic resistance	$M^0_{Rk,s}$	[Nm]	7,6	18,7	37,4	65,5	166,5
Partial safety factor ¹⁾	γ_{Ms}	[-]			1,25		
Steel failure with rod with inner thread grade 8.8							
Characteristic resistance	$M^0_{Rk,s}$	[Nm]	12,2	30,0	59,8	104,8	266,4
Partial safety factor ¹⁾	γ_{Ms}	[-]			1,25		
Steel failure with stainless steel for rod with inner thread A4-70							
Characteristic resistance	$M^0_{Rk,s}$	[Nm]	10,7	26,2	52,3	91,7	233,1
Partial safety factor ¹⁾	γ_{Ms}	[-]			1,56		
Steel failure with stainless steel for rod with inner thread A4-80							
Characteristic resistance	$M^0_{Rk,s}$	[Nm]	12,2	30,0	59,8	104,8	266,4
Partial safety factor ¹⁾	γ_{Ms}	[-]			1,33		
Steel failure with high corrosion resistant steel grade 70							
Characteristic resistance	$M^0_{Rk,s}$	[Nm]	10,7	26,2	52,3	91,7	233,1
Partial safety factor ¹⁾	γ_{Ms}	[-]			1,56		

¹⁾ In the absence of other national regulation.

Table C12: Characteristic resistance under shear loads – pry out and concrete edge failure for rod with inner thread

Size			M6/Ø10	M8/Ø12	M10/Ø16	M12/Ø16	M16/Ø24
Pry out failure							
Factor	k_B	[-]			2		
Concrete edge failure							
Outside diameter of anchor	d_{nom}	[mm]	10	12	16	16	24
Effective length of anchor under shear loading	l_f	[mm]			$l_f = h_{ef} \text{ and } \leq 12 d_{nom}$		

**EVOLUTION II plus / EVO II plus / EVOLUTION 2+ / EV 2+,
EVOLUTION II plus Standard / EVO II plus Standard /
EVOLUTION 2+ (S) / EV 2+ (S) and EVOLUTION II plus Winter /
EVO II plus Winter / EVOLUTION 2+ (W) / EV 2+ (W)**

Characteristic resistance under shear loads for threaded rod
in cracked and non-cracked concrete

Annex C11
of European
Technical Assessment
ETA-21/0767

Table C13: Characteristic resistance under shear loads for rebar – steel failure without lever arm

Size			Ø8	Ø10	Ø12	Ø14	Ø16	Ø20	Ø25	Ø32
Steel failure with rebar										
Characteristic resistance	$V_{Rk,s}$	[kN]	$0,5 \cdot A_s^{2)} \cdot f_{uk}^{3)}$							
Factor considering ductility	k_7	[-]	0,8							
Partial safety factor ¹⁾	γ_{Ms}	[-]	1,5							

¹⁾ In the absence of other national regulation.²⁾ Stressed cross section of the steel element.³⁾ Acc. to EN 1992-1-1.**Table C14: Characteristic resistance under shear loads for rebar – steel failure with lever arm**

Size			Ø8	Ø10	Ø12	Ø14	Ø16	Ø20	Ø25	Ø32
Steel failure with rebar										
Characteristic resistance	$M_{Rk,s}^0$	[Nm]	$1,2 \cdot W_{ef}^{2)} \cdot f_{uk}^{3)}$							
Partial safety factor ¹⁾	γ_{Ms}	[-]	1,5							

¹⁾ In the absence of other national regulation.²⁾ Elastic section modulus calculated from the stressed cross section of steel element.³⁾ Acc. to EN 1992-1-1.**Table C15: Characteristic resistance under shear loads – pry out and concrete edge failure for rebar**

Size			Ø8	Ø10	Ø12	Ø14	Ø16	Ø20	Ø25	Ø32	
Pry out failure											
Factor	k ₈	[-]	2								
Concrete edge failure											
Outside diameter of anchor	d _{nom}	[mm]	8	10	12	14	16	20	25	32	
Effective length of anchor under shear loading	l _f	[mm]	l _f = h _{ef} and ≤ 12 d _{nom}							l _f = h _{ef} and ≤ max (8 · d _{nom} ; 300 mm)	

**EVOLUTION II plus / EVO II plus / EVOLUTION 2+ / EV 2+,
EVOLUTION II plus Standard / EVO II plus Standard /
EVOLUTION 2+ (S) / EV 2+ (S) and EVOLUTION II plus Winter /
EVO II plus Winter / EVOLUTION 2+ (W) / EV 2+ (W)**

Characteristic resistance under shear loads
in cracked and non-cracked concrete

Annex C12
of European
Technical Assessment
ETA-21/0767

Table C16: Displacement under tension loads – threaded rod

Size			M8	M10	M12	M16	M20	M24	M30
Characteristic displacement in uncracked concrete C20/25 to C50/60 under tension loads									
Displacement ¹⁾	δ_{N0}	[mm]	0,3	0,4	0,4	0,5	0,5	0,6	0,7
	$\delta_{N\infty}$	[mm]	0,6	0,6	0,6	0,6	0,6	0,6	0,6
Characteristic displacement in cracked concrete C20/25 to C50/60 under tension loads									
Displacement ¹⁾	δ_{N0}	[mm]	0,3	0,4	0,4	0,5	0,5	0,6	0,6
	$\delta_{N\infty}$	[mm]	2	2	2	2	2	2	2
¹⁾ These values are suitable for each temperature range and categories specified in Annex B1. Calculation of the displacement: $\delta_{N0} = \delta_{N0\text{-factor}} \cdot N$; $\delta_{N\infty} = \delta_{N\infty\text{-factor}} \cdot N$; (N – applied tension load)									

Table C17: Displacement under shear loads – threaded rod

Size			M8	M10	M12	M16	M20	M24	M30
Characteristic displacement in cracked and uncracked concrete C20/25 to C50/60 under shear loads									
Displacement ¹⁾	δ_{V0}	[mm]	2,5	2,5	2,5	2,5	2,5	2,5	2,5
	$\delta_{V\infty}$	[mm]	3,7	3,7	3,7	3,7	3,7	3,7	3,7
¹⁾ These values are suitable for each temperature range and categories specified in Annex B1. Calculation of the displacement: $\delta_{V0} = \delta_{V0\text{-factor}} \cdot V$; $\delta_{V\infty} = \delta_{V\infty\text{-factor}} \cdot V$; (V – applied shear load)									

EVOLUTION II plus / EVO II plus / EVOLUTION 2+ / EV 2+,
EVOLUTION II plus Standard / EVO II plus Standard /
EVOLUTION 2+ (S) / EV 2+ (S) and EVOLUTION II plus Winter /
EVO II plus Winter / EVOLUTION 2+ (W) / EV 2+ (W)

Displacement under service loads: tension and shear loads – threaded rod

Annex C13
of European
Technical Assessment
ETA-21/0767

Table C18: Displacement under tension loads – rod with inner thread

Size			M6/ Ø10	M8/ Ø12	M10/ Ø16	M12/ Ø16	M16/ Ø24
Characteristic displacement in uncracked concrete C20/25 to C50/60 under tension loads							
Displacement ¹⁾	δ_{N0}	[mm]	0,2	0,3	0,3	0,4	0,4
	$\delta_{N\infty}$	[mm]	0,6	0,6	0,6	0,6	0,6
Characteristic displacement in cracked concrete C20/25 to C50/60 under tension loads							
Displacement ¹⁾	δ_{N0}	[mm]	0,3	0,4	0,4	0,5	0,3
	$\delta_{N\infty}$	[mm]	2	2	2	2	2
¹⁾ These values are suitable for each temperature range and categories specified in Annex B1. Calculation of the displacement: $\delta_{N0} = \delta_{N0\text{-factor}} \cdot N$; $\delta_N = \delta_{N\infty\text{-factor}} \cdot N$; (N – applied tension load)							

Table C19: Displacement under shear loads – rod with inner thread

Size			M6/ Ø10	M8/ Ø12	M10/ Ø16	M12/ Ø16	M16/ Ø24
Characteristic displacement in cracked and uncracked concrete C20/25 to C50/60 under shear loads							
Displacement ¹⁾	δ_{V0}	[mm]	2,5	2,5	2,5	2,5	2,5
	$\delta_{V\infty}$	[mm]	3,7	3,7	3,7	3,7	3,7
¹⁾ These values are suitable for each temperature range and categories specified in Annex B1. Calculation of the displacement: $\delta_{V0} = \delta_{V0\text{-factor}} \cdot V$; $\delta_V = \delta_{V\infty\text{-factor}} \cdot V$; (V – applied shear load)							

EVOLUTION II plus / EVO II plus / EVOLUTION 2+ / EV 2+,
 EVOLUTION II plus Standard / EVO II plus Standard /
 EVOLUTION 2+ (S) / EV 2+ (S) and EVOLUTION II plus Winter /
 EVO II plus Winter / EVOLUTION 2+ (W) / EV 2+ (W)

Displacement under service loads: tension and shear loads – rod with inner thread

Annex C14
 of European
 Technical Assessment
 ETA-21/0767

Table C20: Displacement under tension loads – rebar

Size			Ø8	Ø10	Ø12	Ø14	Ø16	Ø20	Ø25	Ø32
Characteristic displacement in uncracked concrete C20/25 to C50/60 under tension loads										
Displacement ¹⁾	δ_{N0}	[mm]	0,3	0,3	0,4	0,4	0,5	0,6	0,6	0,8
	$\delta_{N\infty}$	[mm]	0,6	0,6	0,6	0,6	0,6	0,6	0,6	0,6
Characteristic displacement in cracked concrete C20/25 to C50/60 under tension loads										
Displacement ¹⁾	δ_{N0}	[mm]	0,3	0,3	0,3	0,4	0,5	0,6	0,6	0,7
	$\delta_{N\infty}$	[mm]	2	2	2	2	2	2	2	2
¹⁾ These values are suitable for each temperature range and categories specified in Annex B1. Calculation of the displacement: $\delta_{N0} = \delta_{N0}^{factor} \cdot N$; $\delta_N = \delta_{N\infty}^{factor} \cdot N$; (N – applied tension load)										

Table C21: Displacement under shear loads – rebar

Size			Ø8	Ø10	Ø12	Ø14	Ø16	Ø20	Ø25	Ø32
Characteristic displacement in cracked and uncracked concrete C20/25 to C50/60 under shear loads										
Displacement ¹⁾	δ_{V0}	[mm]	2,5	2,5	2,5	2,5	2,5	2,5	2,5	2,5
	$\delta_{V\infty}$	[mm]	3,7	3,7	3,7	3,7	3,7	3,7	3,7	3,7
¹⁾ These values are suitable for each temperature range and categories specified in Annex B1. Calculation of the displacement: $\delta_{V0} = \delta_{V0}^{factor} \cdot V$; $\delta_V = \delta_{V\infty}^{factor} \cdot V$; (V – applied shear load)										

EVOLUTION II plus / EVO II plus / EVOLUTION 2+ / EV 2+,
 EVOLUTION II plus Standard / EVO II plus Standard /
 EVOLUTION 2+ (S) / EV 2+ (S) and EVOLUTION II plus Winter /
 EVO II plus Winter / EVOLUTION 2+ (W) / EV 2+ (W)

Displacement under service loads: tension and shear loads – rebar

Annex C15
 of European
 Technical Assessment
 ETA-21/0767

Table C22: Characteristic resistance under tension load for threaded rod for seismic performance category C1

Size			M8	M10	M12	M16	M20	M24	M30
Steel failure									
Steel failure with threaded rod grade 5.8									
Characteristic resistance	$N_{Rk,s,seis}$	[kN]	18	29	42	78	122	176	280
Partial safety factor ¹⁾	$\gamma_{Ms,seis}$	[-]	1,50						
Steel failure with threaded rod grade 8.8									
Characteristic resistance	$N_{Rk,s,seis}$	[kN]	29	46	67	125	196	282	448
Partial safety factor ¹⁾	$\gamma_{Ms,seis}$	[-]	1,50						
Steel failure with stainless steel threaded rod A4-70									
Characteristic resistance	$N_{Rk,s,seis}$	[kN]	25	40	59	109	171	247	392
Partial safety factor ¹⁾	$\gamma_{Ms,seis}$	[-]	1,87						
Steel failure with stainless steel threaded rod A4-80									
Characteristic resistance	$N_{Rk,s,seis}$	[kN]	29	46	67	125	196	282	448
Partial safety factor ¹⁾	$\gamma_{Ms,seis}$	[-]	1,60						
Steel failure with high corrosion resistant steel grade 70									
Characteristic resistance	$N_{Rk,s,seis}$	[kN]	25	40	59	109	171	247	392
Partial safety factor ¹⁾	$\gamma_{Ms,seis}$	[-]	1,87						
Combined pull-out and concrete cone failure in uncracked concrete C20/25 for a working life of 50 years									
Characteristic bond resistance									
Temperature range I: 24°C / 40°C	$\tau_{Rk,ucr,seis,50}$	[N/mm ²]	8,0	10,0	10,0	9,5	7,5	7,0	4,0
Temperature range II: 50°C / 80°C	$\tau_{Rk,ucr,seis,50}$	[N/mm ²]	8,0	10,0	10,0	9,5	7,5	7,0	4,0
Temperature range II: 80°C / 120°C	$\tau_{Rk,ucr,seis,50}$	[N/mm ²]	4,5	5,0	6,0	5,0	4,0	4,0	2,0
Combined pull-out and concrete cone failure in uncracked concrete C20/25 for a working life of 100 years									
Characteristic bond resistance									
Temperature range I: 24°C / 40°C	$\tau_{Rk,ucr,seis,100}$	[N/mm ²]	8,0	9,0	10,0	9,5	7,5	7,0	4,0
Temperature range II: 50°C / 80°C	$\tau_{Rk,ucr,seis,100}$	[N/mm ²]	8,0	9,0	10,0	9,5	7,5	7,0	4,0

Table C23: Characteristic resistance under tension load for rebar for seismic performance category C1

Size			Ø8	Ø10	Ø12	Ø14	Ø16	Ø20	Ø25	Ø32
Steel failure with rebar										
Characteristic resistance	N _{Rk,s,seis}	[kN]	A _s ²⁾ · f _{yk} ³⁾							
Partial safety factor ¹⁾	γ _{Ms, seis}	[-]	1,40							
Combined pull-out and concrete cone failure in uncracked concrete C20/25 for a working life of 50 years										
Characteristic bond resistance										
Temperature range I: 24°C / 40°C	τ _{Rk,ucr,seis,50}	[N/mm ²]	7,0	8,5	10,0	10,0	8,5	7,5	6,0	3,5
Temperature range II: 50°C / 80°C	τ _{Rk,ucr,seis,50}	[N/mm ²]	7,0	8,5	10,0	10,0	8,5	7,5	6,0	3,5
Temperature range II: 80°C / 120°C	τ _{Rk,ucr,seis,50}	[N/mm ²]	4,0	4,5	5,0	5,0	4,5	4,0	3,0	1,5
Combined pull-out and concrete cone failure in uncracked concrete C20/25 for a working life of 100 years										
Characteristic bond resistance										
Temperature range I: 24°C / 40°C	τ _{Rk,ucr,seis,100}	[N/mm ²]	6,0	8,5	10,0	10,0	8,5	7,5	6,0	3,5
Temperature range II: 50°C / 80°C	τ _{Rk,ucr,seis,100}	[N/mm ²]	6,0	8,5	10,0	10,0	8,5	7,5	6,0	3,5

¹⁾ In the absence of other national regulation.²⁾ Stressed cross section of the steel element.³⁾ Acc. to EN 1992-1-1.

**EVOLUTION II plus / EVO II plus / EVOLUTION 2+ / EV 2+,
EVOLUTION II plus Standard / EVO II plus Standard /
EVOLUTION 2+ (S) / EV 2+ (S) and EVOLUTION II plus Winter /
EVO II plus Winter / EVOLUTION 2+ (W) / EV 2+ (W)**

Characteristic resistance under tension loads for threaded and rebar
for seismic action category C1

Annex C16
of European
Technical Assessment
ETA-21/0767

Table C24: Characteristic resistance under shear loads for threaded rod for seismic performance category C1 - steel failure without lever arm

Size			M8	M10	M12	M16	M20	M24	M30
Steel failure with threaded rod grade 5.8									
Characteristic resistance	$V_{Rk,s,seis}$	[kN]	6,3	10,1	14,7	27,3	42,7	61,6	98,0
Partial safety factor ¹⁾	$\gamma_{Ms, seis}$	[-]	1,25						
Steel failure with threaded rod grade 8.8									
Characteristic resistance	$V_{Rk,s, seis}$	[kN]	10,2	16,1	23,5	44,1	68,6	98,7	156,8
Partial safety factor ¹⁾	$\gamma_{Ms, seis}$	[-]	1,25						
Steel failure with stainless steel threaded rod A4-70									
Characteristic resistance	$V_{Rk,seis}$	[kN]	9,1	14,4	20,7	38,5	59,9	86,5	137,4
Partial safety factor ¹⁾	$\gamma_{Ms, seis}$	[-]	1,56						
Steel failure with stainless steel threaded rod A4-80									
Characteristic resistance	$V_{Rk,seis}$	[kN]	10,2	16,1	23,5	44,1	68,6	98,7	157,2
Partial safety factor ¹⁾	$\gamma_{Ms, seis}$	[-]	1,33						
Steel failure with high corrosion stainless steel grade 70									
Characteristic resistance	$V_{Rk,seis}$	[kN]	9,1	14,4	20,7	38,5	59,9	86,5	137,4
Partial safety factor ¹⁾	$\gamma_{Ms, seis}$	[-]	1,56						

¹⁾ In the absence of other national regulation.

Table C25: Characteristic resistance under shear loads for rebar for seismic performance category C1 – steel failure without lever arm

Size			Ø8	Ø10	Ø12	Ø14	Ø16	Ø20	Ø25	Ø32
Steel failure with rebar										
Characteristic resistance	$V_{Rk,s,seis}$	[kN]	$0,35 \cdot A_s^{2)} \cdot f_{yk}^{3)}$							
Partial safety factor ¹⁾	$\gamma_{Ms,seis}$	[-]	1,5							

¹⁾ In the absence of other national regulation.

²⁾ Stressed cross section of the steel element.

³⁾ Acc. to EN 1992-1-1.

**EVOLUTION II plus / EVO II plus / EVOLUTION 2+ / EV 2+,
EVOLUTION II plus Standard / EVO II plus Standard /
EVOLUTION 2+ (S) / EV 2+ (S) and EVOLUTION II plus Winter /
EVO II plus Winter / EVOLUTION 2+ (W) / EV 2+ (W)**

Characteristic resistance under shear loads for threaded and rebar
for seismic action category C1

Annex C17
of European
Technical Assessment
ETA-21/0767

Table C26: Displacement under tension loads – threaded rod for seismic performance category C1

Size			M8	M10	M12	M16	M20	M24	M30
Displacement	$\delta_{N,seis}$	[mm]	3,0	3,1	3,5	4,0	5,0	6,0	6,6

Table C27: Displacement under shear loads – threaded rod for seismic performance category C1

Size			M8	M10	M12	M16	M20	M24	M30
Displacement	$\delta_{V,seis}$	[mm]	3,5	4,0	4,6	5,0	5,8	6,5	7,0

Table C28: Displacement under tension loads – rebar for seismic performance category C1

Size			Ø8	Ø10	Ø12	Ø14	Ø16	Ø20	Ø25	Ø32
Displacement	$\delta_{N,seis}$	[mm]	3,0	3,1	3,5	4,0	4,0	5,0	6,0	6,4

Table C29: Displacement under shear loads – rebar for seismic performance category C1

Size			Ø8	Ø10	Ø12	Ø14	Ø16	Ø20	Ø25	Ø32
Displacement	$\delta_{V,seis}$	[mm]	3,5	4,0	4,6	5,0	5,0	5,8	6,5	7,2

**EVOLUTION II plus / EVO II plus / EVOLUTION 2+ / EV 2+,
EVOLUTION II plus Standard / EVO II plus Standard /
EVOLUTION 2+ (S) / EV 2+ (S) and EVOLUTION II plus Winter /
EVO II plus Winter / EVOLUTION 2+ (W) / EV 2+ (W)**

Displacement under service loads: tension and shear loads
for seismic action category C1

Annex C18
of European
Technical Assessment
ETA-21/0767